


PROJECT DATATABLE - SINGLE FAMILY DWELLING		
Zoning	RS1 - Langford	
Address	Strata Lot 10 - 924 Rosefinch Place	
Lot Size	201.00m ² (2,152.78 ft ²)	
	Proposed	Allowed
Lot coverage (Total)	36.04% 77.44m ²	50% 100.65m ²
Setbacks		
Front Setback	5.39m	3.00m
Front <u>Garage</u> Setback	6.00m	6.00m
Rear Setback	3.00m	3.00m
Side Setback (East)	1.50m	1.50m
Side Setback (West)	1.50m	1.50m
Driveway Width	5.79m	6.00m
Height		
Building Height	9.02m	11.00m
Floor Area		
Suite Floor Area	34.39 m ² (370.14 ft ²)	
House Lower Floor Area	9.59 m ² (103.25 ft ²)	
Main Floor Area	62.85 m ² (676.53 ft ²)	
Upper Floor Area	65.38 m ² (703.78 ft ²)	
Total Gross Floor Area	171.56 m ² (1853.7 ft ²)	
Garage Area	18.99 m ² (204.42 ft ²)	

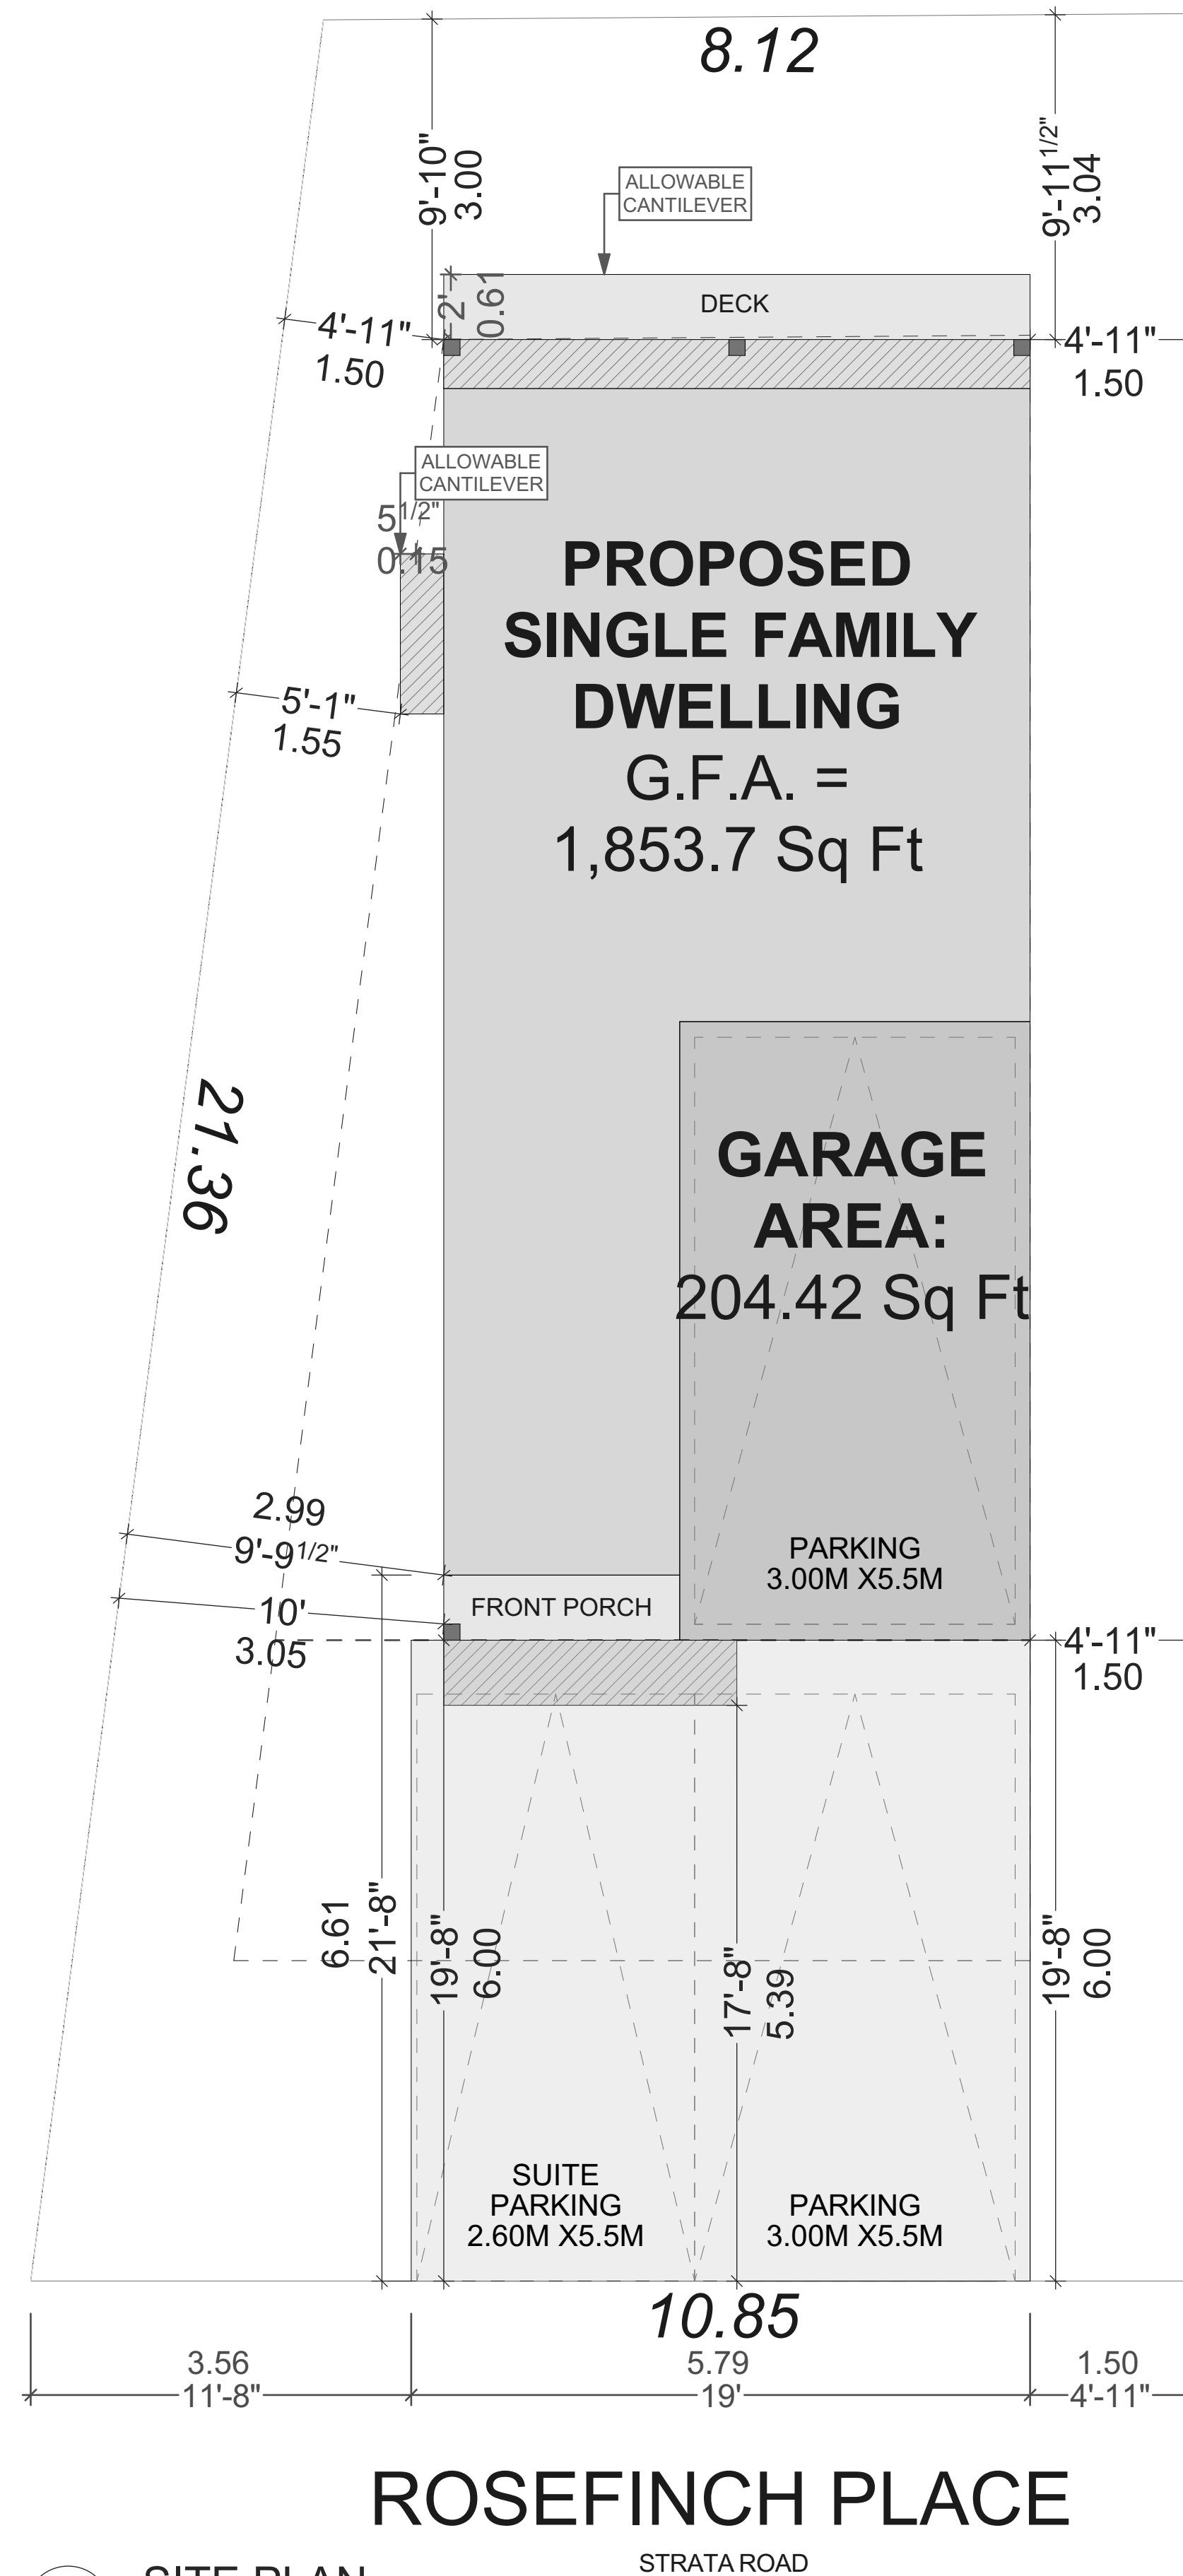


ROSEFINCH PLACE
STRATA ROAD

SITE PLAN
SCALE: 1 : 50

SL 10

AREA = 201.00 M²

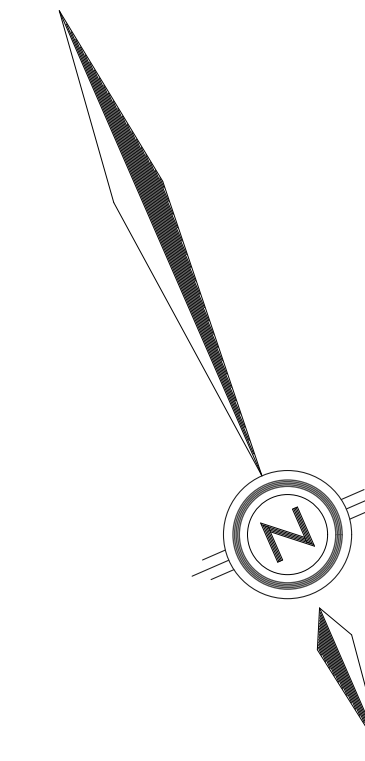

ADDRESS:
SL 10 - 924 ROSEFINCH PLACE,
LANGFORD
CUSTOMER:
TEKLOCH HOMES LTD.

DRAWING NAME:
SITE PLAN & DATA BOX
DRAWING SCALE:
SEE DRAWINGS

ISSUE DATE:
FEB 20, 2025
DRAWN BY:
LS
CHECKED BY:
KL

102 - 2871 JACKLIN ROAD
VICTORIA BC V9B 0P3
JAVADESIGNS.CA
250.590.2468



REQUIRED ENERGY STEP CODE

3

GENERAL NOTES
ALL MATERIALS AND CONSTRUCTION METHODS TO CONFORM TO THE CURRENT EDITION OF THE BRITISH COLUMBIA BUILDING CODE AS WELL AS ANY LOCAL BUILDING CODES OR BYLAWS WHICH MAY TAKE PRECEDENCE.
ALL MEASUREMENTS MUST BE VERIFIED ON SITE BY BUILDER PRIOR TO CONSTRUCTION, AND ANY DISCREPANCIES REPORTED TO THE DESIGNER.
DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALE
DRAFTED ELEMENTS ARE FRAMED ONLY, NO ALLOWANCES HAVE BEEN ADDED FOR FINISHING ELEMENTS SUCH AS BUT NOT LIMITED TO G.W.B. CLADDING, SHEATHING, ETC.
-SMOKE DETECTORS SHALL BE PROVIDED ON EVERY FLOOR

SITE PLAN
ALL LAYOUTS SHOULD BE CONFIRMED BY A REGISTERED B.C. LAND SURVEYOR.
ALL SETBACKS SHALL BE CONFIRMED BY THE OWNER/BUILDER
ALL GRADE ELEVATIONS ARE THE RESPONSIBILITY OF THE OWNER/BUILDER AND ANY MODIFICATIONS ARE TO BE MADE ON SITE.
CONFORMITY OF THESE PLANS TO THE ACTUAL SITE IS THE RESPONSIBILITY OF THE OWNER/BUILDER.
CONCRETE AND FOUNDATIONS
ALL CONCRETE FOOTINGS TO HAVE SOLID BEARING ON COMPACTED, UNDISTURBED INORGANIC SOIL TO A SUITABLE DEPTH BELOW FROST PENETRATION.

IF SOFTER CONDITIONS APPLY, THE SOLID BEARING CAPACITY AND SIZE OF FOOTINGS ARE TO BE DESIGNED BY A QUALIFIED ENGINEER.
GARAGE & CARPORT FLOORS AND EXTERIOR STEPS SHALL NOT BE LESS THAN 32 MPa
FOUNDATION CONCRETE SHALL HAVE MIN. COMPRESSIVE STRENGTH OF 2900 psi (20MPa) AT 28 DAYS, MIXED, PLACED AND TESTED IN ACCORDANCE WITH CAN3-A438.
ALL WALLS ARE 8" CONCRETE UNLESS OTHERWISE NOTED.
ALL GRADES ARE ESTIMATED ONLY AND SHALL BE ADJUSTED ON SITE.
ALL WOOD IN CONTACT WITH CONCRETE SHALL BE TREATED OR SEPARATED BY A MOISTURE RESISTANT GASKET MATERIAL.

LUMBER, FRAMING, AND BEAMS
BUILDING FRAMES TO BE ANCHORED TO FOUNDATION BY FASTENING SILL PLATE TO FOUNDATION WITH NOT LESS THAN 12.7mm DIAM ANCHOR BOLTS AT NOT MORE THAN 2.4M O.C.
ALL ENGINEERED BEAMS TO BE SIZED BY SUPPLIER.
ALL SPANS SHALL CONFORM TO THE TABLES SET OUT IN "THE SPAN BOOK" AND THE NATIONAL BUILDING CODE OF CANADA AND VERIFICATIONS OF ALL SPANS IS THE RESPONSIBILITY OF THE OWNER/BUILDER.

TRUSSES
TRUSSES AND LAYOUT ARE TO BE ENGINEERED AND INSTALLED ACCORDING TO MANUFACTURER'S SPECIFICATIONS, INCLUDING ALL BRACING.
ROOFING
ALL ROOFING SHALL BE APPLIED TO MANUFACTURER'S SPECIFICATION AND SHALL INCLUDE EAVE PROTECTION FROM ICE DAMS AND SNOW BUILD UP.
PLUMBING & ELECTRICAL
ANY ELECTRICAL SHOWN ON PLANS IS TO SERVE AS A GUIDE ONLY AND MUST BE INSTALLED BY A QUALIFIED PERSONNEL.


FLASHING
-ALL EXPOSED OPENINGS SHALL BE PROVIDED WITH ADEQUATE FLASHING.
ALL ROOFING SHALL INCORPORATE STEP FLASHING.
ALL PENETRATIONS THROUGH ROOF SHALL INCLUDE APPROPRIATE FLASHING.
DOORS - ROUGH OPENING SIZES
FRAME OPENING 1 1/4" WIDER THAN DOOR.
FRAME HEIGHT 83" FOR EXTERIOR DOORS AND 82.5" FOR INTERIOR DOORS.
FRAME OPENING 1 1/4" WIDER THAN BIFOLD DOORS AND FRAME HEIGHT 81.5".

MISC.
CARBON MONOXIDE ALARMS TO BE HARDWIRED AND WITHIN 5M OF EACH BEDROOM IN EVERY SUITE AND INTERCONNECTED TO ALL FLOORS.
CARBON MONOXIDE ALARMS TO CONFORM TO CSA 6.19


NEITHER JAVA DESIGNS INC. NOR THE DESIGNER ACCEPT RESPONSIBILITY FOR THE FOLLOWING:
-INFORMATION PROVIDED ON EXISTING BUILDINGS OR SITE.
-CONFORMITY OF PLANS TO SITE.
-ERRORS AND OMISSIONS.
-ANY HOUSE BUILT FROM THESE PLANS.

SHEET NUMBER

A1

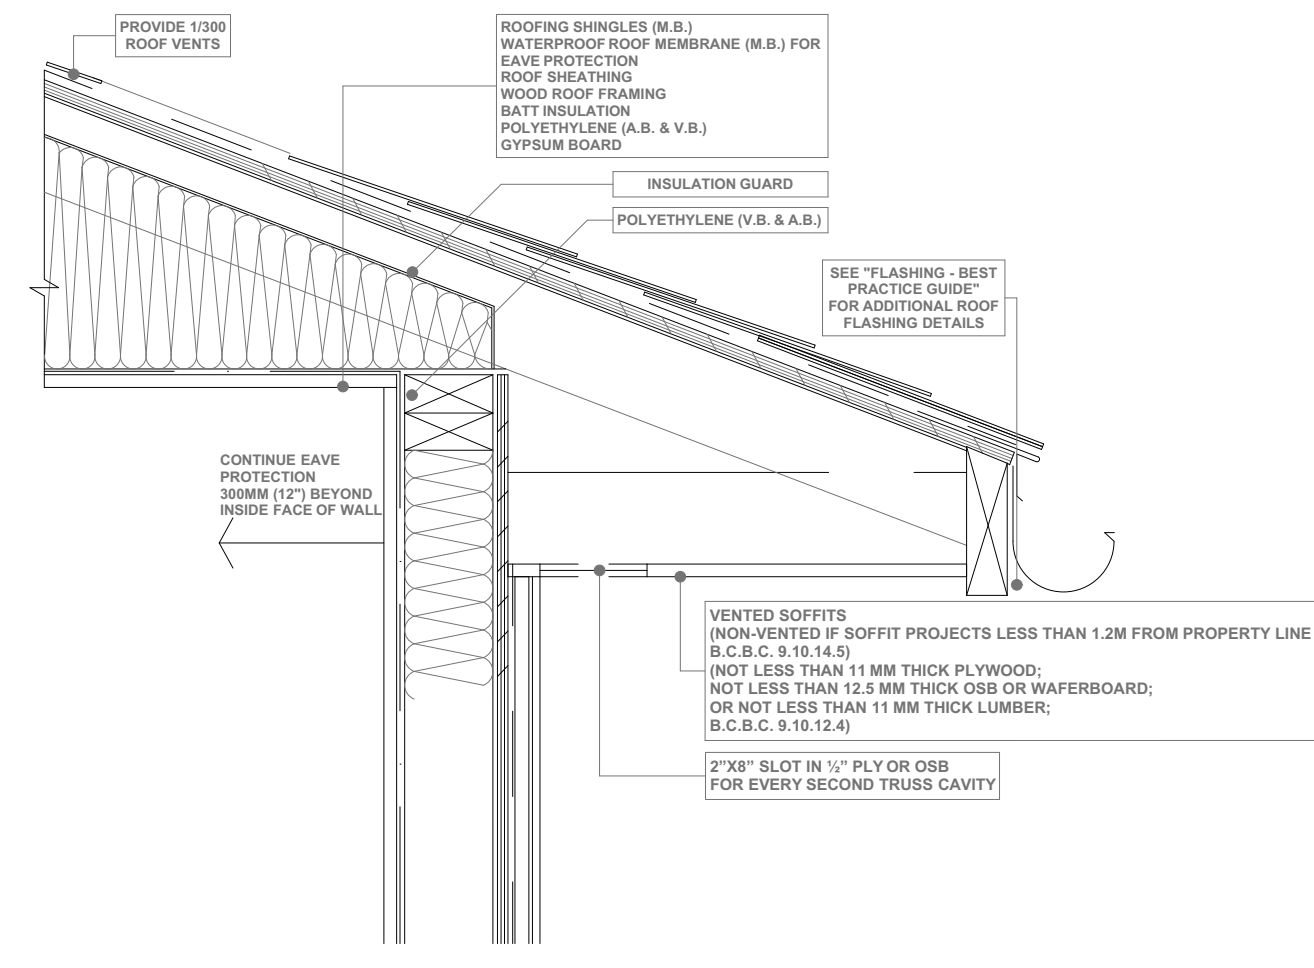

SOFFIT DETAIL
SCALE: 1" = 1' - 0"

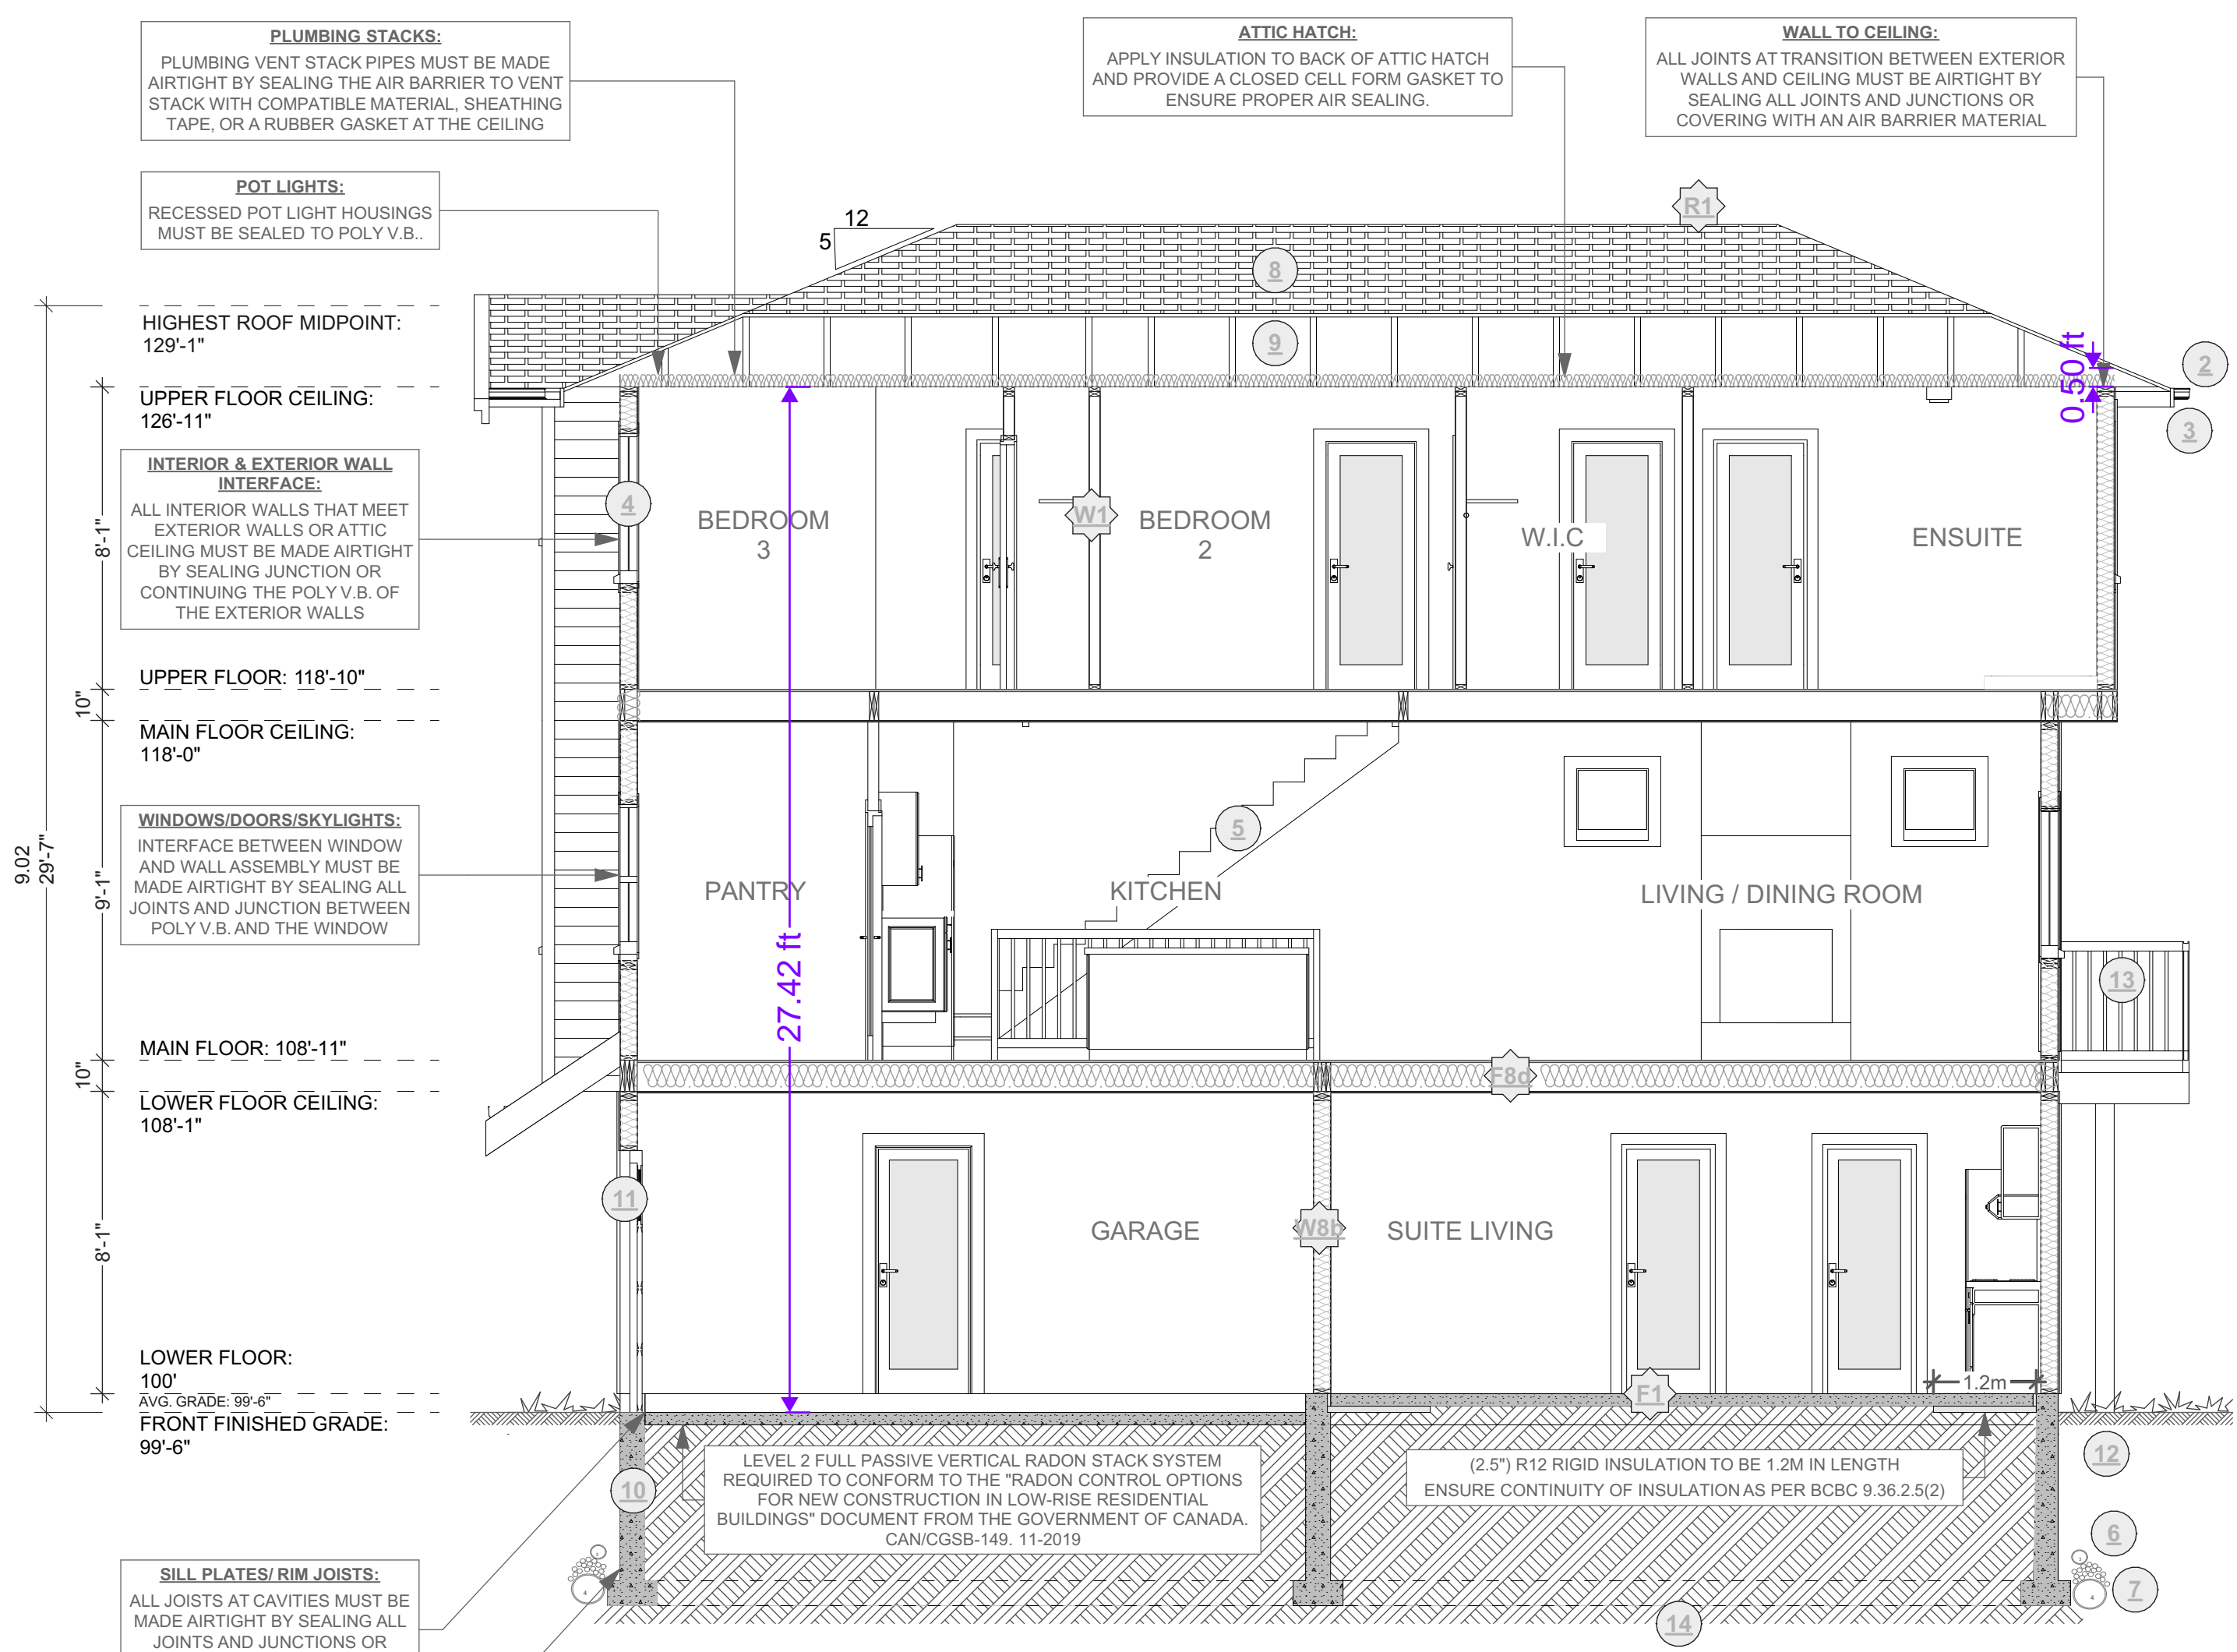

CROSS SECTION A-1
SCALE: 1/4" = 1' - 0"

HOUSE HEAT SOURCE TO BE: DUCTLESS HEAT PUMP WITH COOLING
SUITE HEAT SOURCE TO BE: DUCTLESS HEAT PUMP WITH COOLING

ALL COMPONENTS RELATING TO ENERGY EFFICIENCY (IE. COOLING, HEATING, VENTILATION, WINDOWS, BUILDING ENVELOPE) ARE REQUIRED TO COMPLY WITH STEP 3 OF THE BC ENERGY STEP CODE

REFER TO RADON DETAIL PAGE AND GOVERNMENT OF CANADA CAN/CGSB-149.11-2019 DOCUMENT FOR SPECIFICATIONS


PRINCIPAL EXHAUST FAN:
HOUSE:
PRINCIPAL EXHAUST FAN CAPACITY @50 PASCAL AND MIN. VENTILATION RATE OF 28 AS PER 9.32.3.5 MUST BE WIRED TO RUN CONTINUOUSLY, CONTROLLED BY DEDICATED SWITCH, SOUND RATING NOT TO EXCEED 1.0 SONE(SEE TABLE 9.32.3.3.A)
SUITE:
PRINCIPAL EXHAUST FAN CAPACITY @50 PASCAL AND MIN. VENTILATION RATE OF 14 AS PER 9.32.3.5 MUST BE WIRED TO RUN CONTINUOUSLY, CONTROLLED BY DEDICATED SWITCH, SOUND RATING NOT TO EXCEED 1.0 SONE(SEE TABLE 9.32.3.3.A)

CONSTRUCTION ASSEMBLIES:


- E1** 4" CONCRETE FLOOR ON 6 MIL POLY V.B. COMPACTED GRANULAR FILL
- E2** 2X10 FLOOR JOIST 16" O.C. TYP. NAIL AND GLUE 3/4" T&G PLYWOOD X BRIDGING @ 6" O.C. TYP.
- E3** 2X4 FRAMING 16" O.C. TYP. 1/2" GWB FINISH THROUGHOUT
- E4** EXTERIOR FINISH, 3/4" AIR SPACE, PRESSURE TREATED STRAPPING, SHEATHING PAPER, 1/2" SHEATHING, R-20 BATT INSULATION, 6 MIL. POLY V.B., 1/2" GWB, (SEE ELEVATIONS)
- R1** ASPHALT SHINGLES, BUILDING PAPER, 7/16" O.S.B. (OR 1/2" PLYWOOD), ENGINEERED TRUSSES DESIGNED BY SUPPLIER @ 24" O.C. TYP., R40 BATT INSULATION, 6 MIL U.V. POLY V.B. 5/8" GWB
- W8** DEMISING WALL - (45MIN AS PER W8B - TABLE A-9.10.3.1.A) MINIMUM STC RATING OF 43 AS PER BCBC • 2 LAYERS OF 12.7MM TYPE "X" GYPSUM WALL BOARD TO ONE SIDE • 2 ROWS 38MM X 89MM STUDS SPACED 600MM O.C. STAGGERED ON COMMON 38MM X 140MM PLATE • 89MM THICK ABSORPTIVE MATERIAL ON ONE SIDE • 12.7MM TYPE "X" GYPSUM WALL BOARD ON OTHER SIDE
- F8** DEMISING FLOOR: (30MIN AS PER F8D - TABLE A-9.10.3.1.B) • SUBFLOOR OF 15.5MM PLYWOOD, OSB OR WAFERBOARD, OR 17MM TONGUE AND GROOVE LUMBER • WOOD JOISTS OR WOOD I-JOISTS SPACED MAX. OF 600MM O.C. • ABSORPTIVE MATERIAL IN CAVITY • RESILIENT METAL CHANNELS SPACED 600MM • 15.9MM TYPE "X" GYPSUM WALL BOARD

CONSTRUCTION NOTES:

- R40 INSULATION, 6 MIL POLY V.B. 1/2" CEILING BOARD
- CONTINUOUS GUTTERS
- ALUMINUM GUTTERS AND VENTED SOFFITS - ROOF OVERHANGS AS PER PLANS
- ALL WINDOWS VINYL, SUPPLY RAIN PAN UNDER, RAINSCREEN AS PER BCBC. WINDOWS IN DOORS TO BE SAFETY GLASS
- STAIRS, 7 5/8" RISE, 10.05" TREAD, 1" NOSING WITH CONTINUOUS HANDRAIL
- PROVIDE DRAINS TO PERIMETER SYSTEM
- 4" DRAIN TILE WITH 6" ROCK OVER
- PROVIDE ROOF VENTS: VENT 1/150 USING SHINGLE VENT II RIDGE VENT
- EAVE PROTECTION TO 12" BEYOND HEATED WALL
- 8" CONCRETE WALL ON 8"x16" CONCRETE FOOTINGS • 2#4 BAR CONTINUOUS • R12 RIDGID INSULATION - 2 COATS DAMP PROOFING
- CAULK OVER AND AROUND ALL EXTERIOR OPENINGS
- 10"x10" POST SADDLE ON 6" PILASTER 26"x26" CONCRETE FOOTING (NOT SHOWN)
- 42" NON-CLIMBABLE CONTINUOUS HANDRAIL
- UNDISTURBED NON-ORGANIC SOIL
- ADD INTERCONNECTED PHOTO-ELECTRIC SMOKE ALARM CONFORMING TO ARTICLE 9.37.2.19 DWELLING UNITS TO BE SEPARATED FROM EACH OTHER BY A FIRE SEPARATION HAVING A FIRE-RESISTANCE RATING OF NOT LESS THAN 30 min AS PER 9.37.2.15.(b)
- ALL POT LIGHT CAVITIES IN CEILINGS, PLUMBING BOXES, FANS, ELECTRICAL PANELS IN PARTY WALLS TO BE COMPLETELY SEALED AND FIRE RATED WITH TYPE "X" DRYWALL

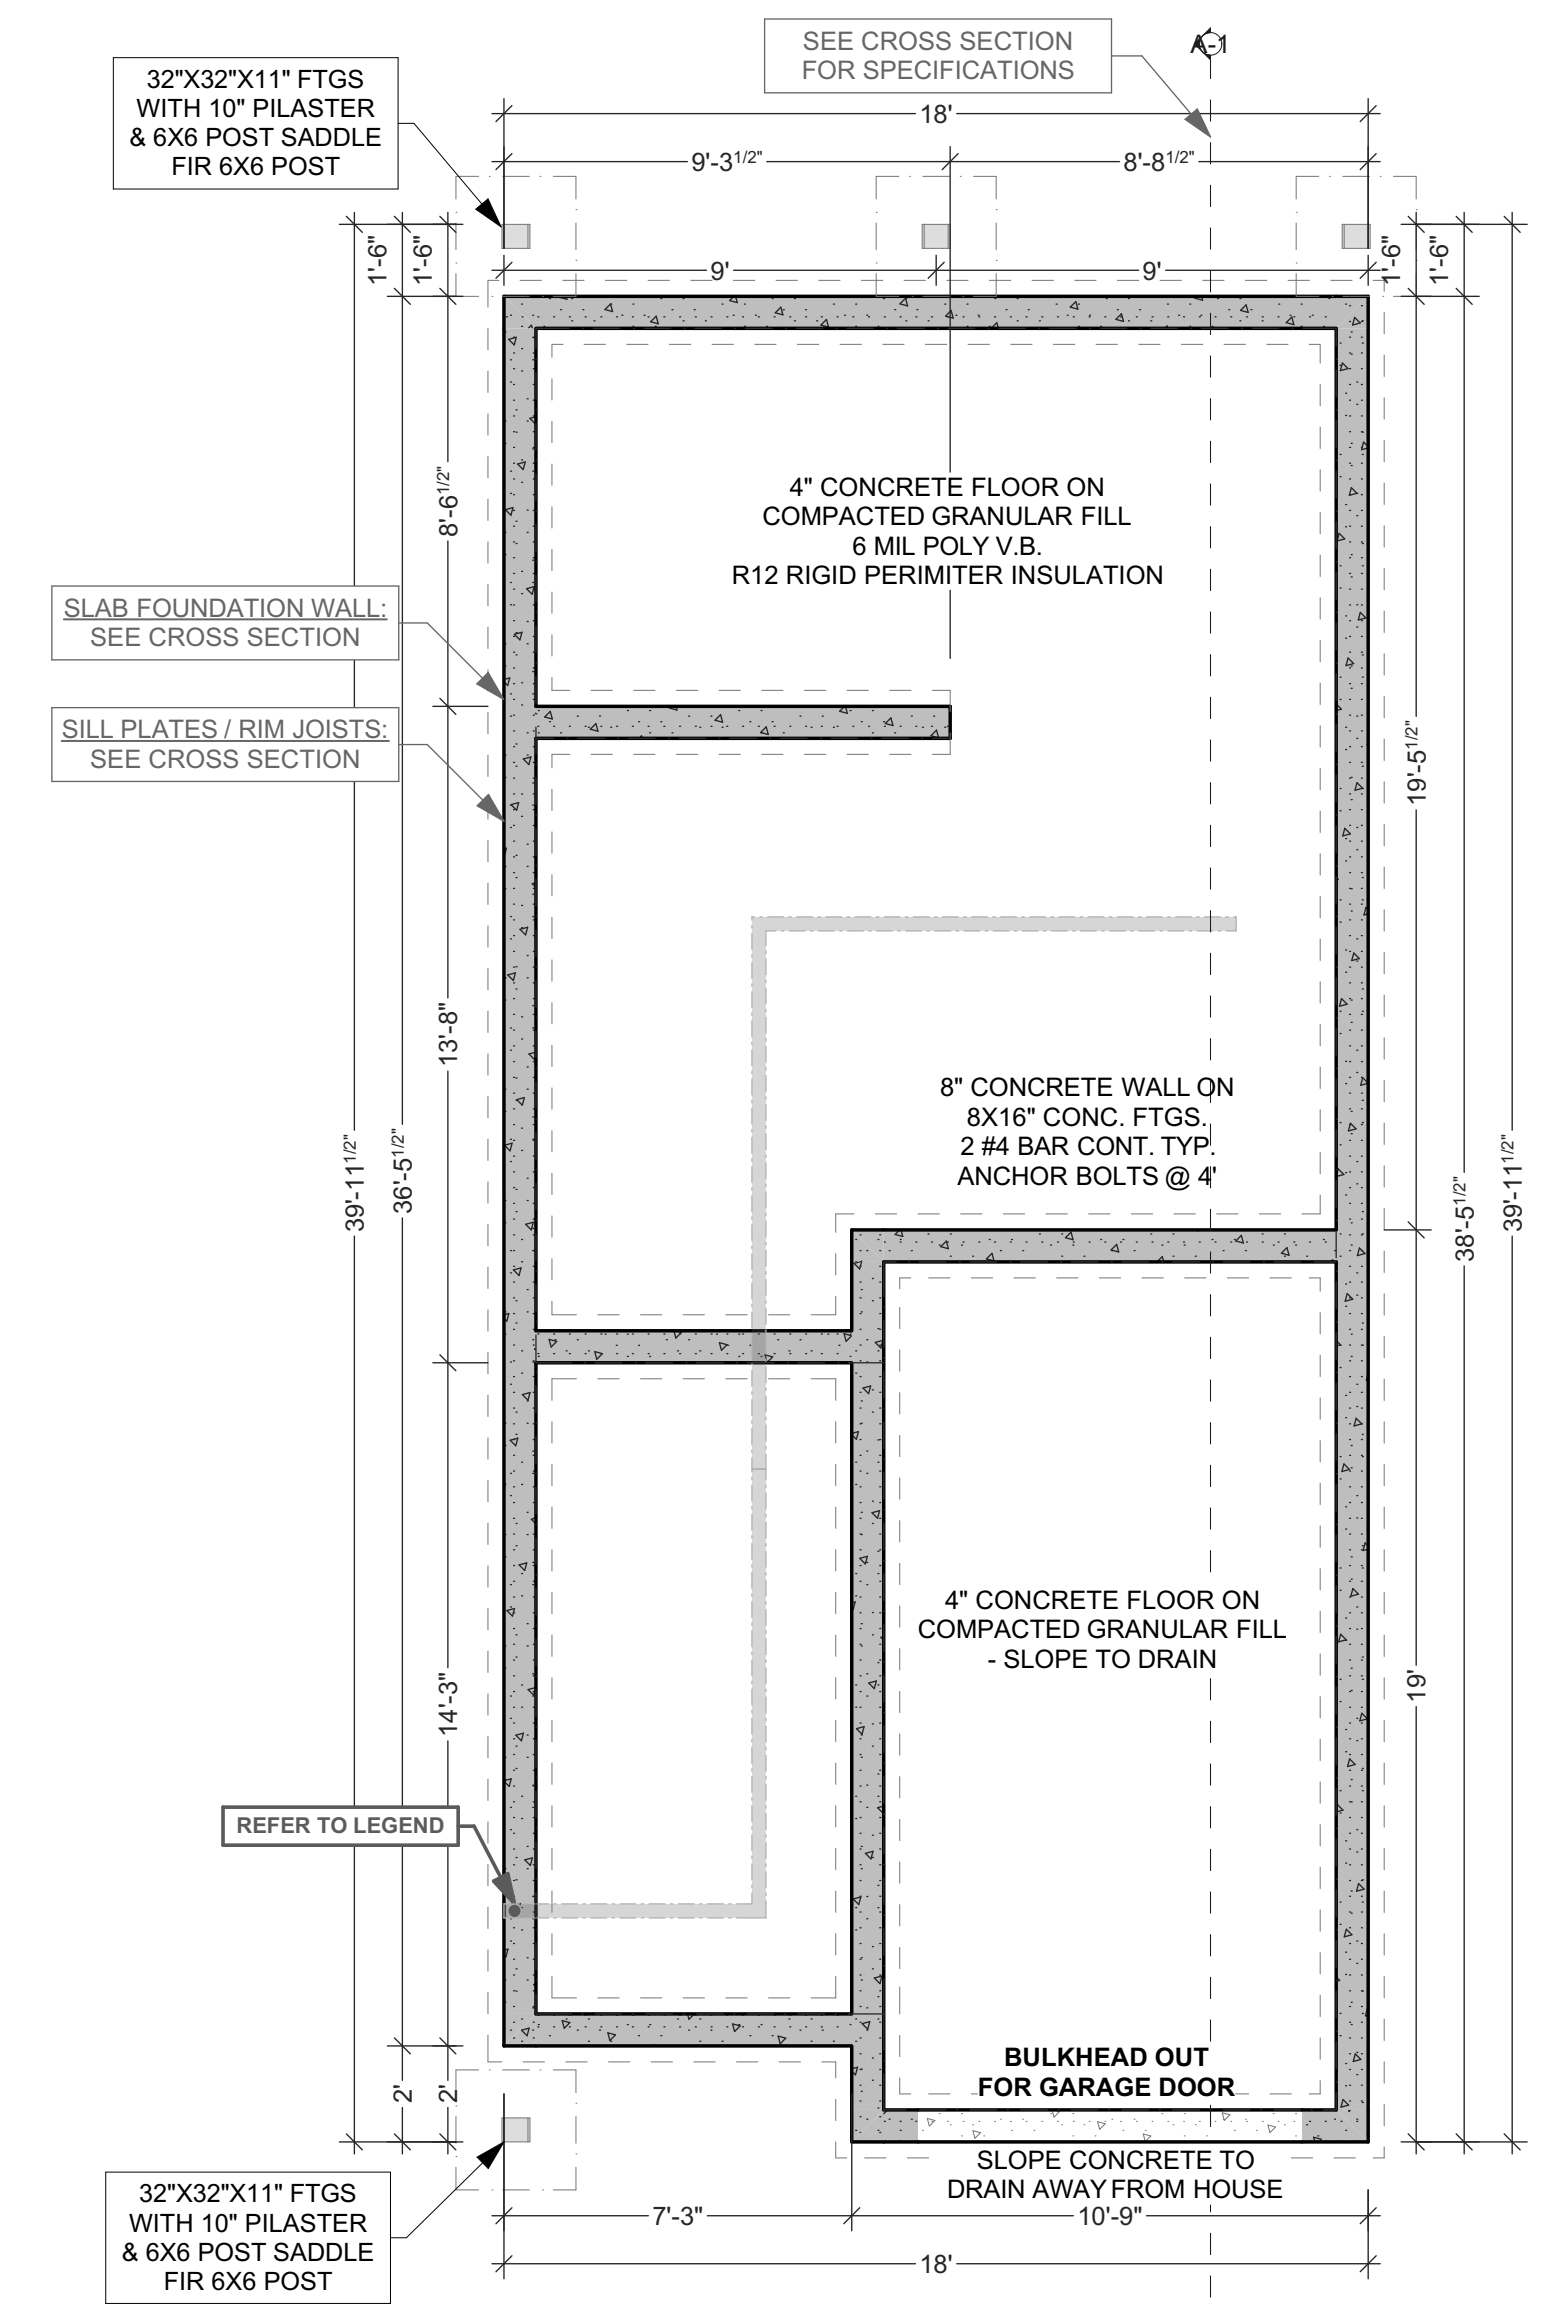

FOUNDATION PLAN
SCALE: 1/4" = 1' - 0"

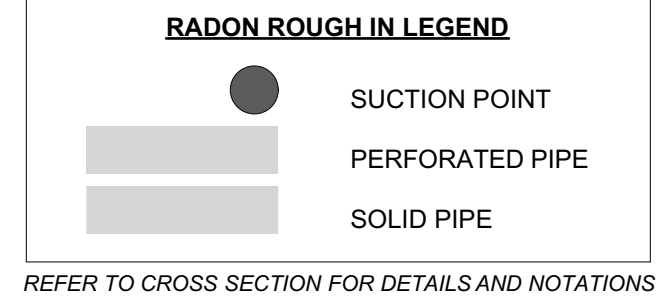

ADDRESS:
SL 10 - 924 ROSEFINCH PLACE,
LANGFORD
CUSTOMER:
TEKLOCH HOMES LTD.

DRAWING NAME:
FOUNDATION PLAN, CROSS SECTION, & DETAILS
DRAWING SCALE:
SEE DRAWINGS

ISSUE DATE:
FEB 20, 2025
DRAWN BY:
LS
CHECKED BY:
KL

102 - 2871 JACKLIN ROAD
VICTORIA BC V9B 0P3
JAVADESIGNS.CA
250.590.2468

JAVA DESIGNS




SHEET NUMBER

A2

LOWER - h=8.083'
L = 105.24 ft
A = 436.85 sf

MAIN - h=9.083'
L = 115.89 ft
A = 663.08 sf

UPPER - h=8.083'
L = 116.24 ft
A = 683.16 sf

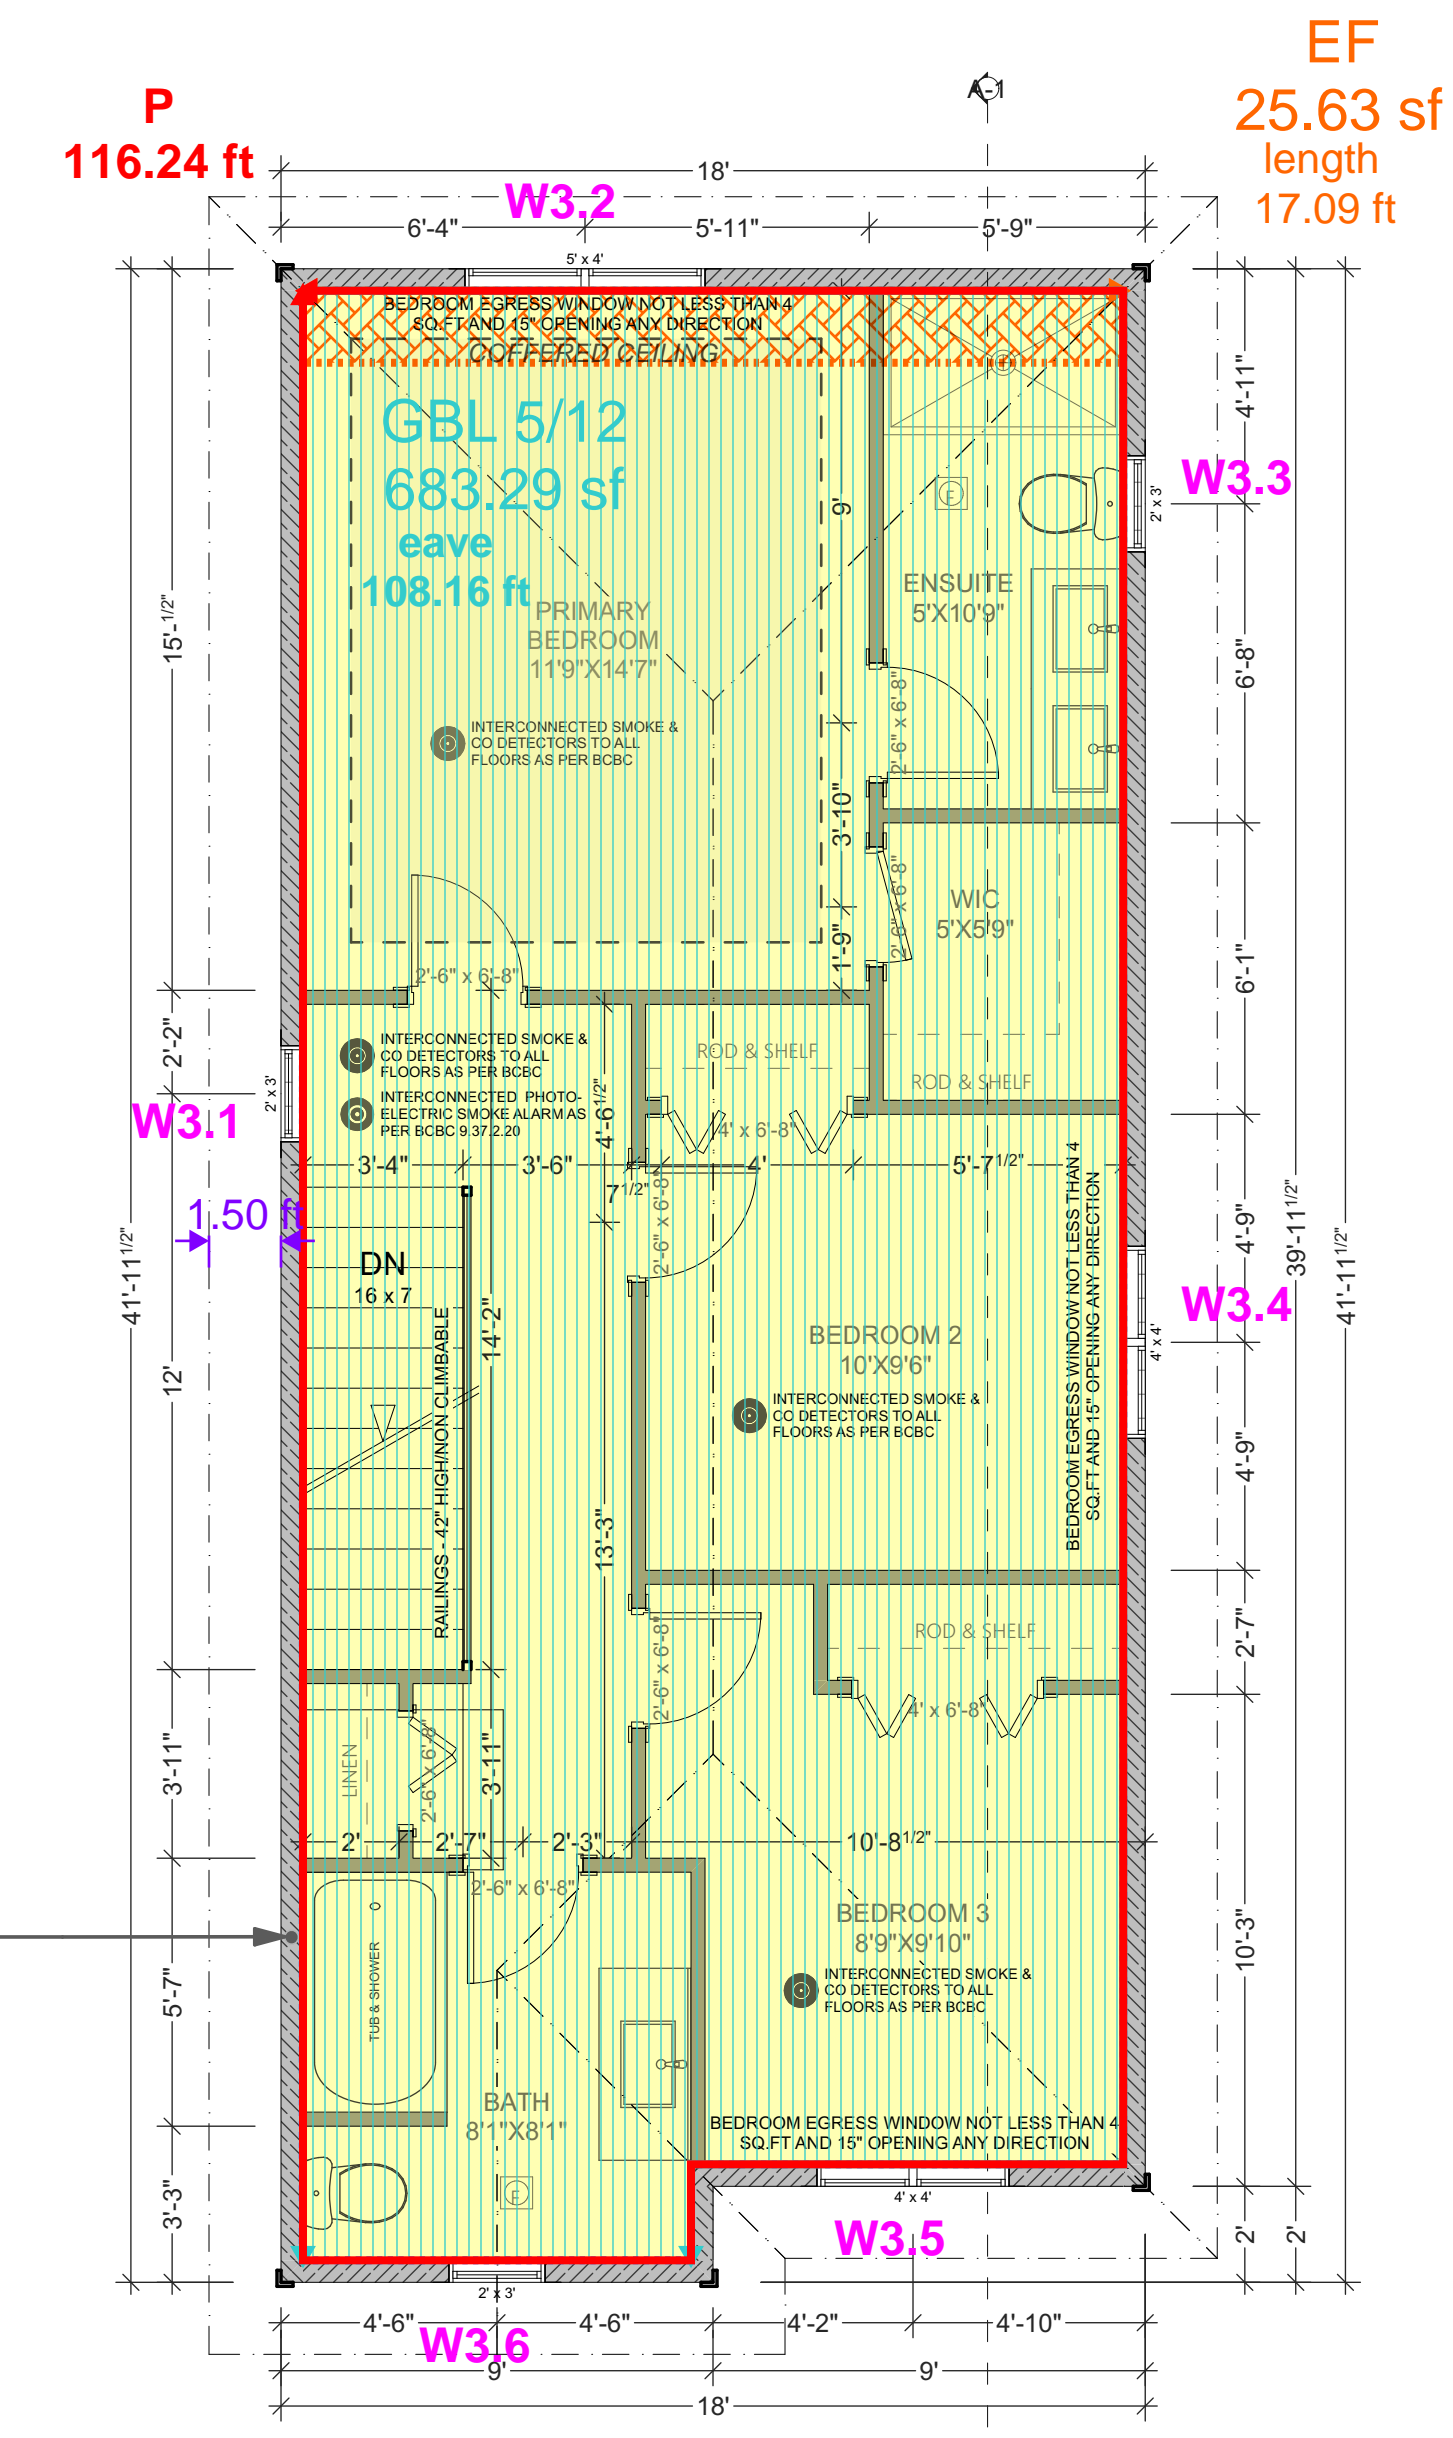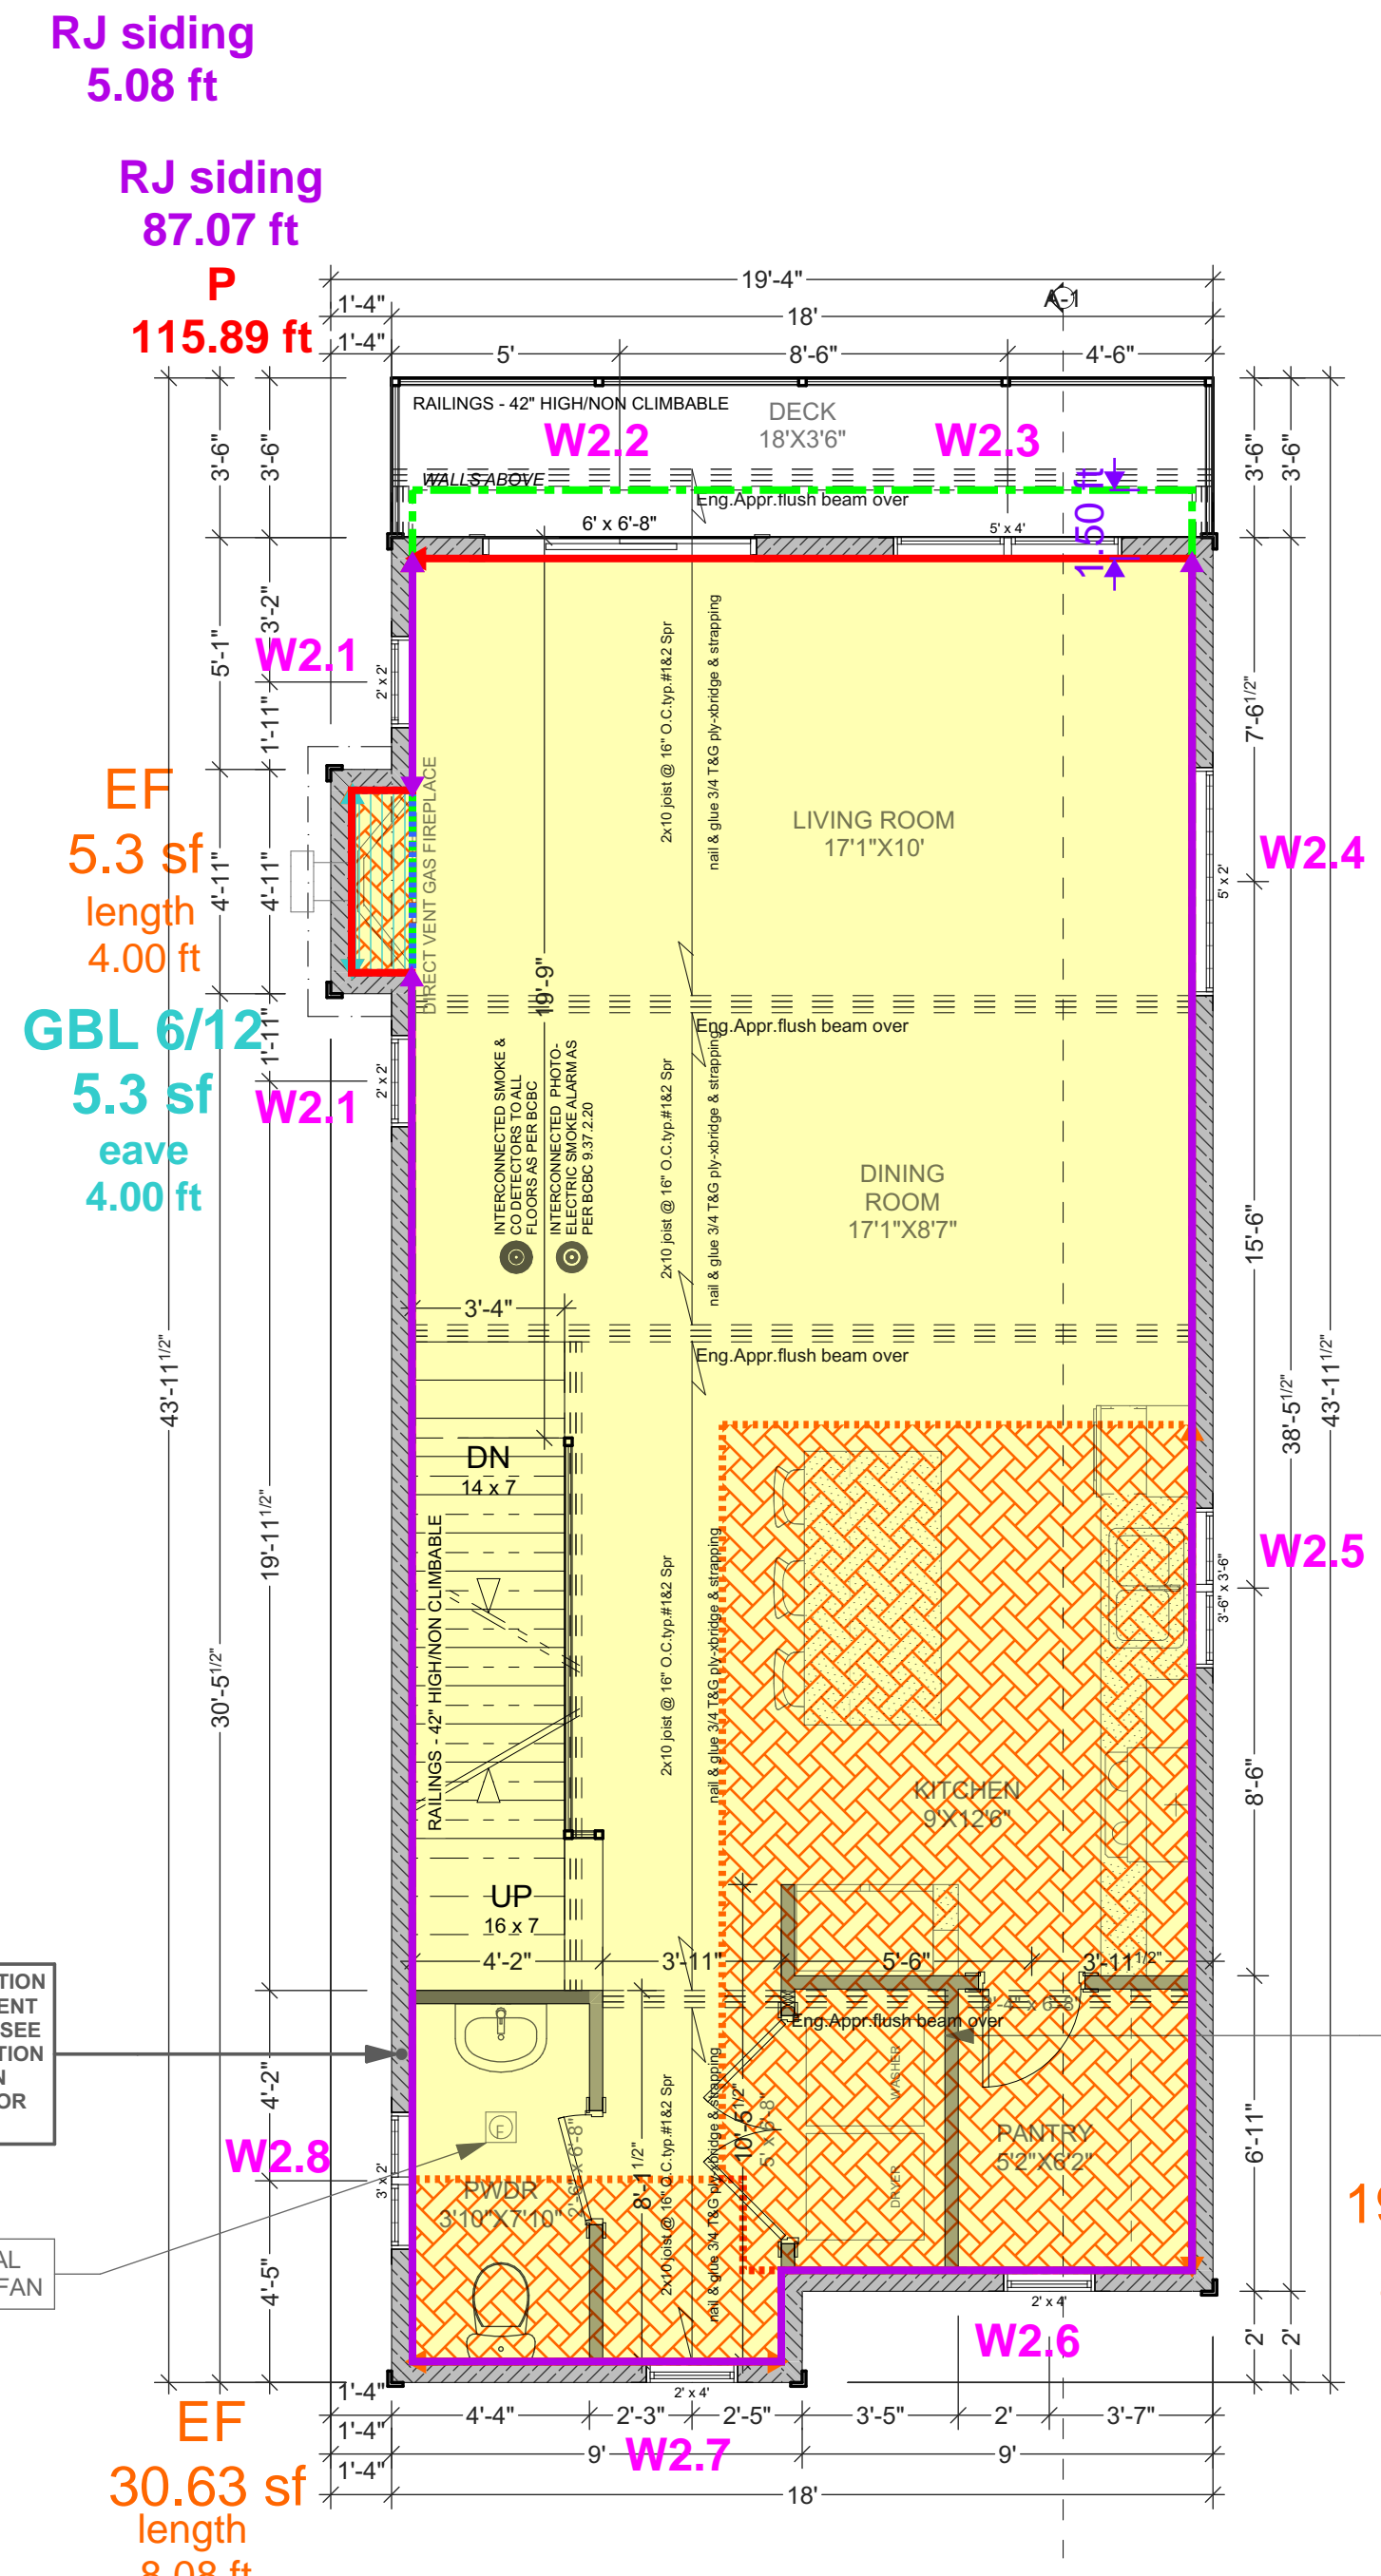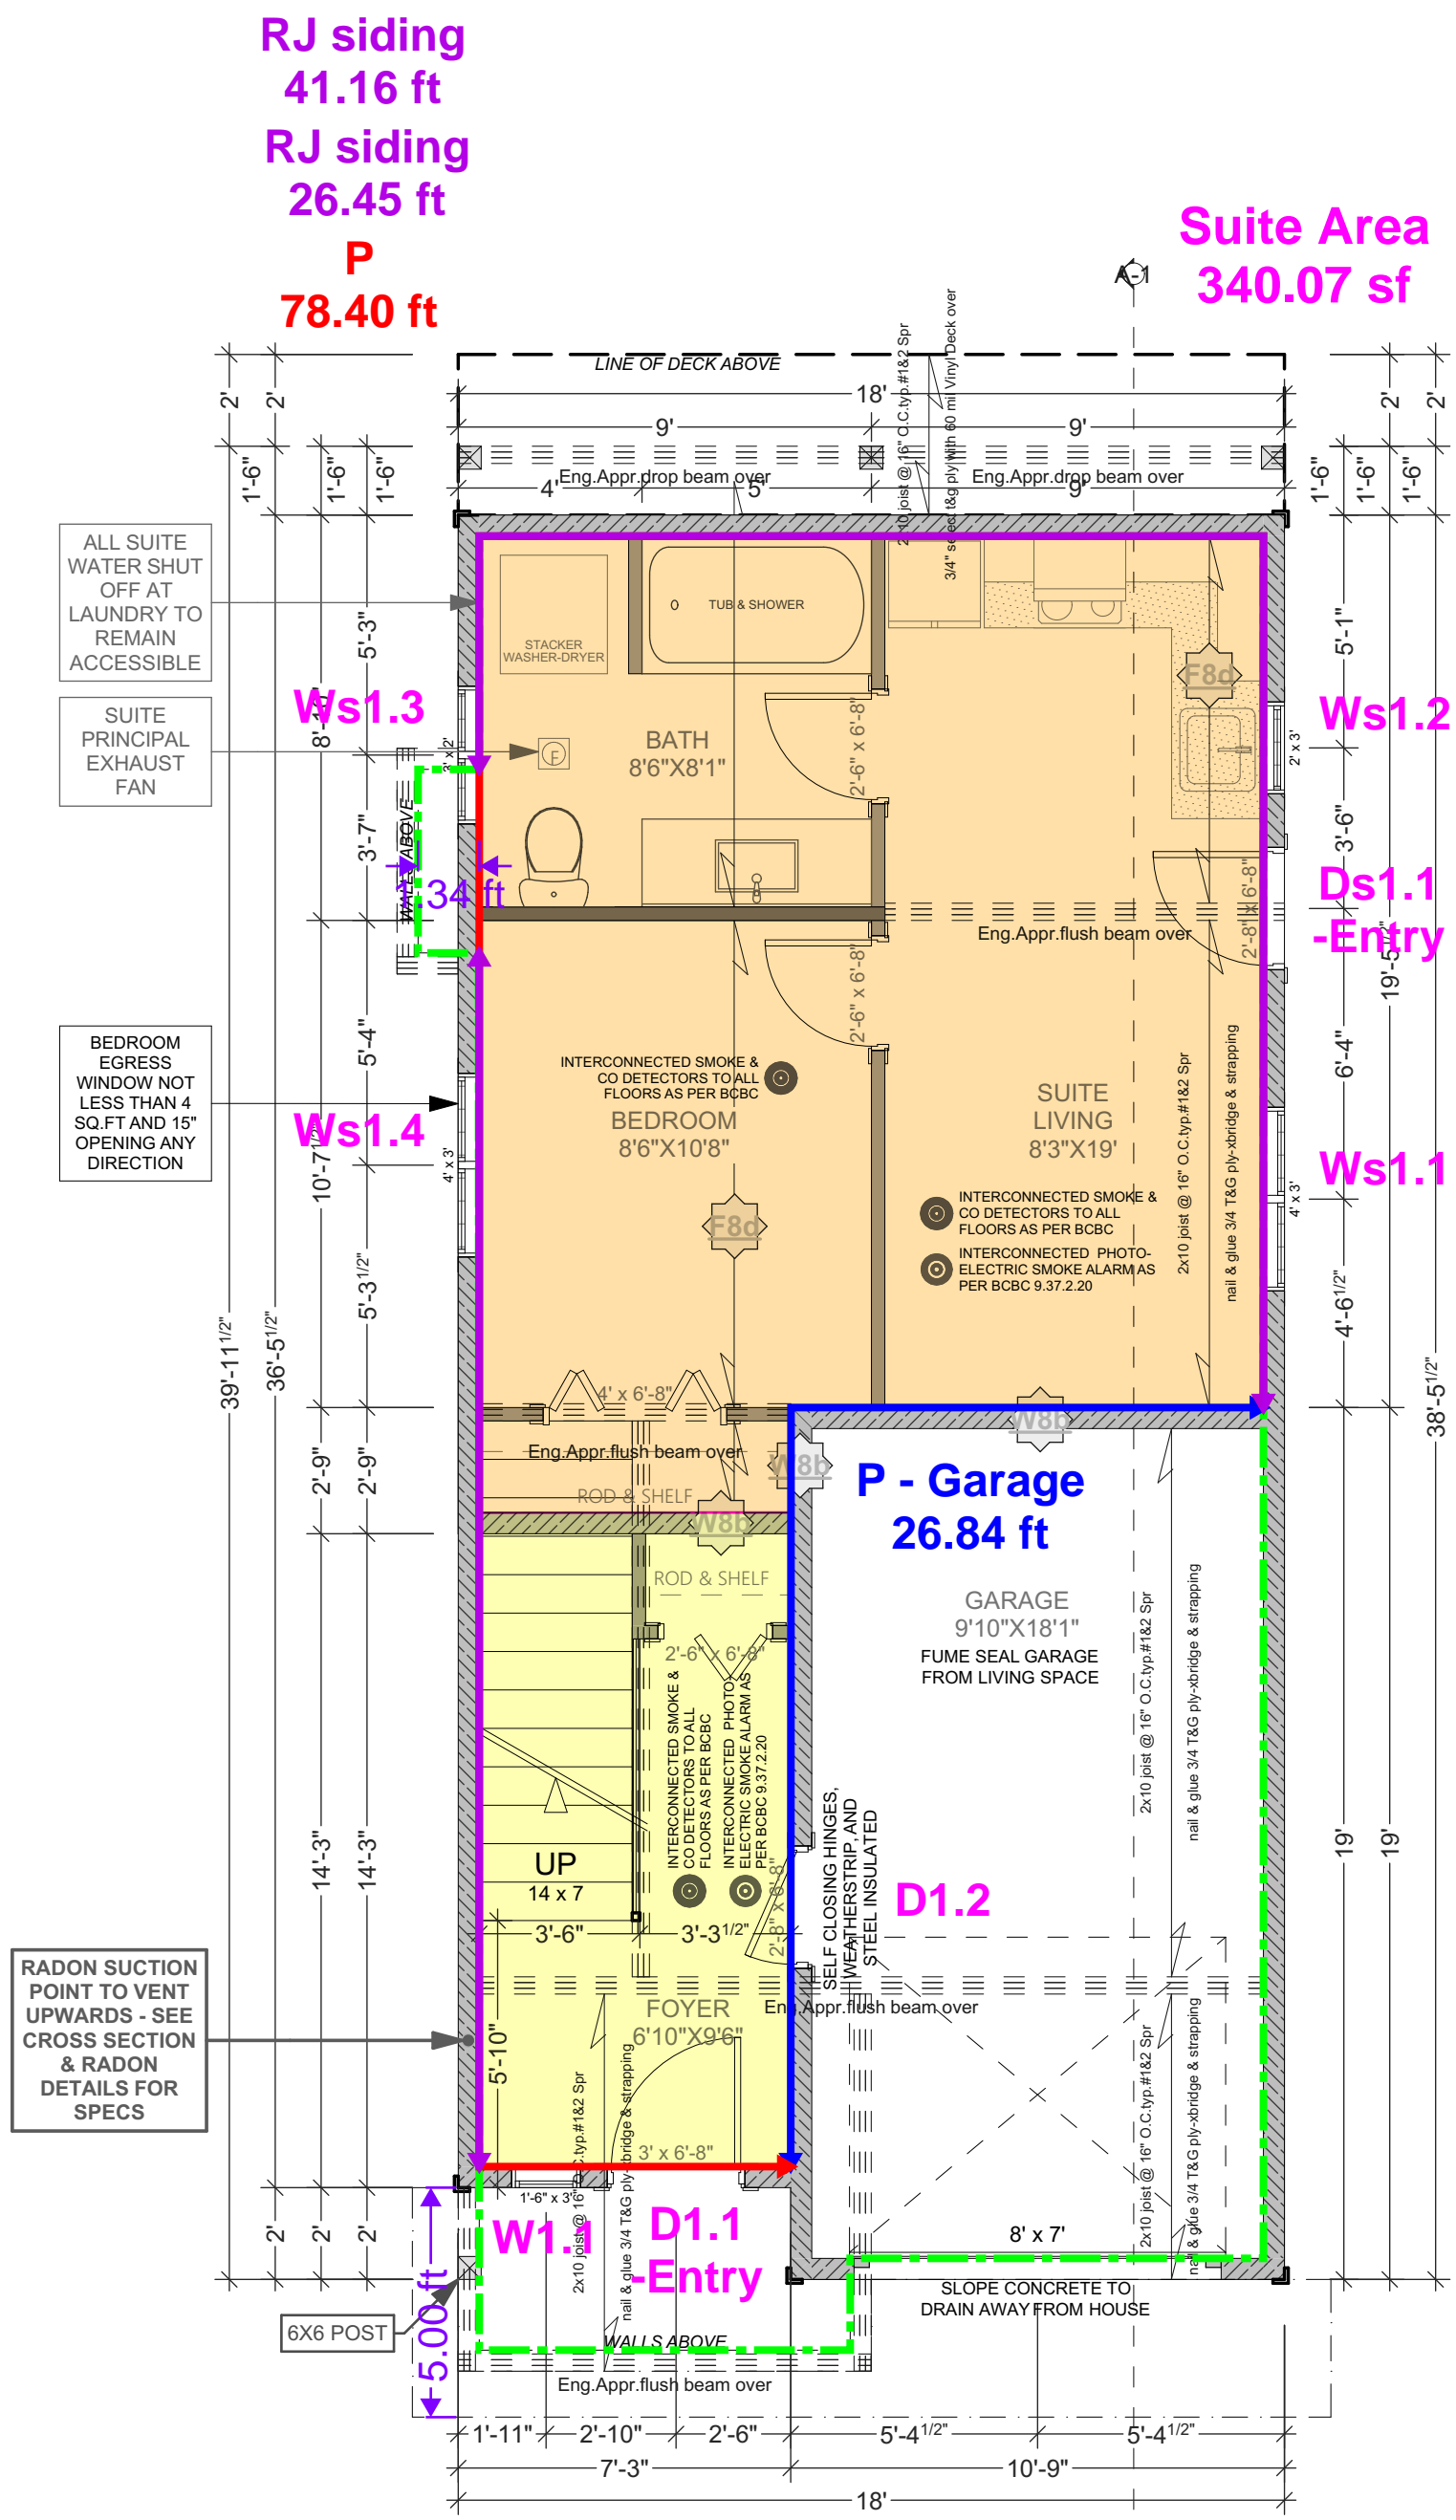

LOWER FLOOR PLAN (8'-0 3/4" WALLS)
SCALE: 1/4" = 1' - 0"
HOUSE FLOOR AREA: 103.25 sq ft
SUITE FLOOR AREA: 370.14 sq ft
TOTAL LOWER FLOOR AREA: 473.39 sq ft
GARAGE FLOOR AREA: 204.42 sq ft

MAIN FLOOR PLAN (9'-0 3/4" WALLS)
SCALE: 1/4" = 1' - 0"
MAIN FLOOR AREA: 676.53 sq ft

UPPER FLOOR PLAN (8'-0 3/4" WALLS)
SCALE: 1/4" = 1' - 0"
UPPER FLOOR AREA: 703.78 sq ft

- DEMISING WALL:**
(45MIN AS PER W98 - TABLE A-9.10.3.1.A)
MINIMUM STC RATING OF 49 AS PER BCBC
• 2 LAYERS OF 12.7MM TYPE "X" GYPSUM WALL BOARD TO ONE SIDE
• 2 ROWS 38MM X 89MM STUDS SPACED 600MM O.C. STAGGERED ON COMMON 38MM X 140MM PLATE
• 89MM THICK ABSORPTIVE MATERIAL ON ONE SIDE
• 12.7MM TYPE "X" GYPSUM WALL BOARD ON OTHER SIDE
- DEMISING FLOOR:**
(30MIN AS PER FRD - TABLE A-9.10.3.1.B)
• SUBFLOOR OF 15.8MM PLYWOOD, OSB OR WAFERBOARD, OR 17MM TONGUE AND GROOVE LUMBER
• WOOD JOISTS OR WOOD I-JOISTS SPACED MAX. OF 600MM O.C.
• ABSORPTIVE MATERIAL IN CAVITY
• RESILIENT METAL CHANNELS SPACED 600MM
• 15.9MM TYPE "X" GYPSUM WALL BOARD


ADD INTERCONNECTED PHOTO-ELECTRIC SMOKE ALARM CONFORMING TO ARTICLE 9.37.2.19.
DWELLING UNITS TO BE SEPARATED FROM EACH OTHER BY A FIRE SEPARATION HAVING A FIRE-RESISTANCE RATING OF NOT LESS THAN 30 min AS PER 9.37.2.15.(b)
ALL POT LIGHT CAVITIES IN CEILINGS, PLUMBING BOXES, FANS, ELECTRICAL PANELS IN PARTY WALLS TO BE COMPLETELY SEALED AND FIRE RATED WITH TYPE "X" DRYWALL

ADDRESS:
SL 10 - 924 ROSEFINCH PLACE,
LANGFORD
CUSTOMER:
TEKLOCH HOMES LTD.

DRAWING NAME:
LOWER, MAIN,
& UPPER FLOOR PLANS
DRAWING SCALE:
1/4"=1'-0" / SEE DRAWINGS


ISSUE DATE:
FEB 20, 2025
DRAWN BY:
LS
CHECKED BY:
KL

102 - 2871 JACKLIN ROAD
VICTORIA BC V9B 0P3
JAVADESIGN.CA
250.590.2468

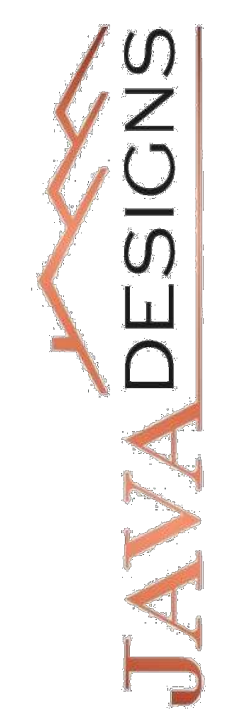


SHEET NUMBER

A3

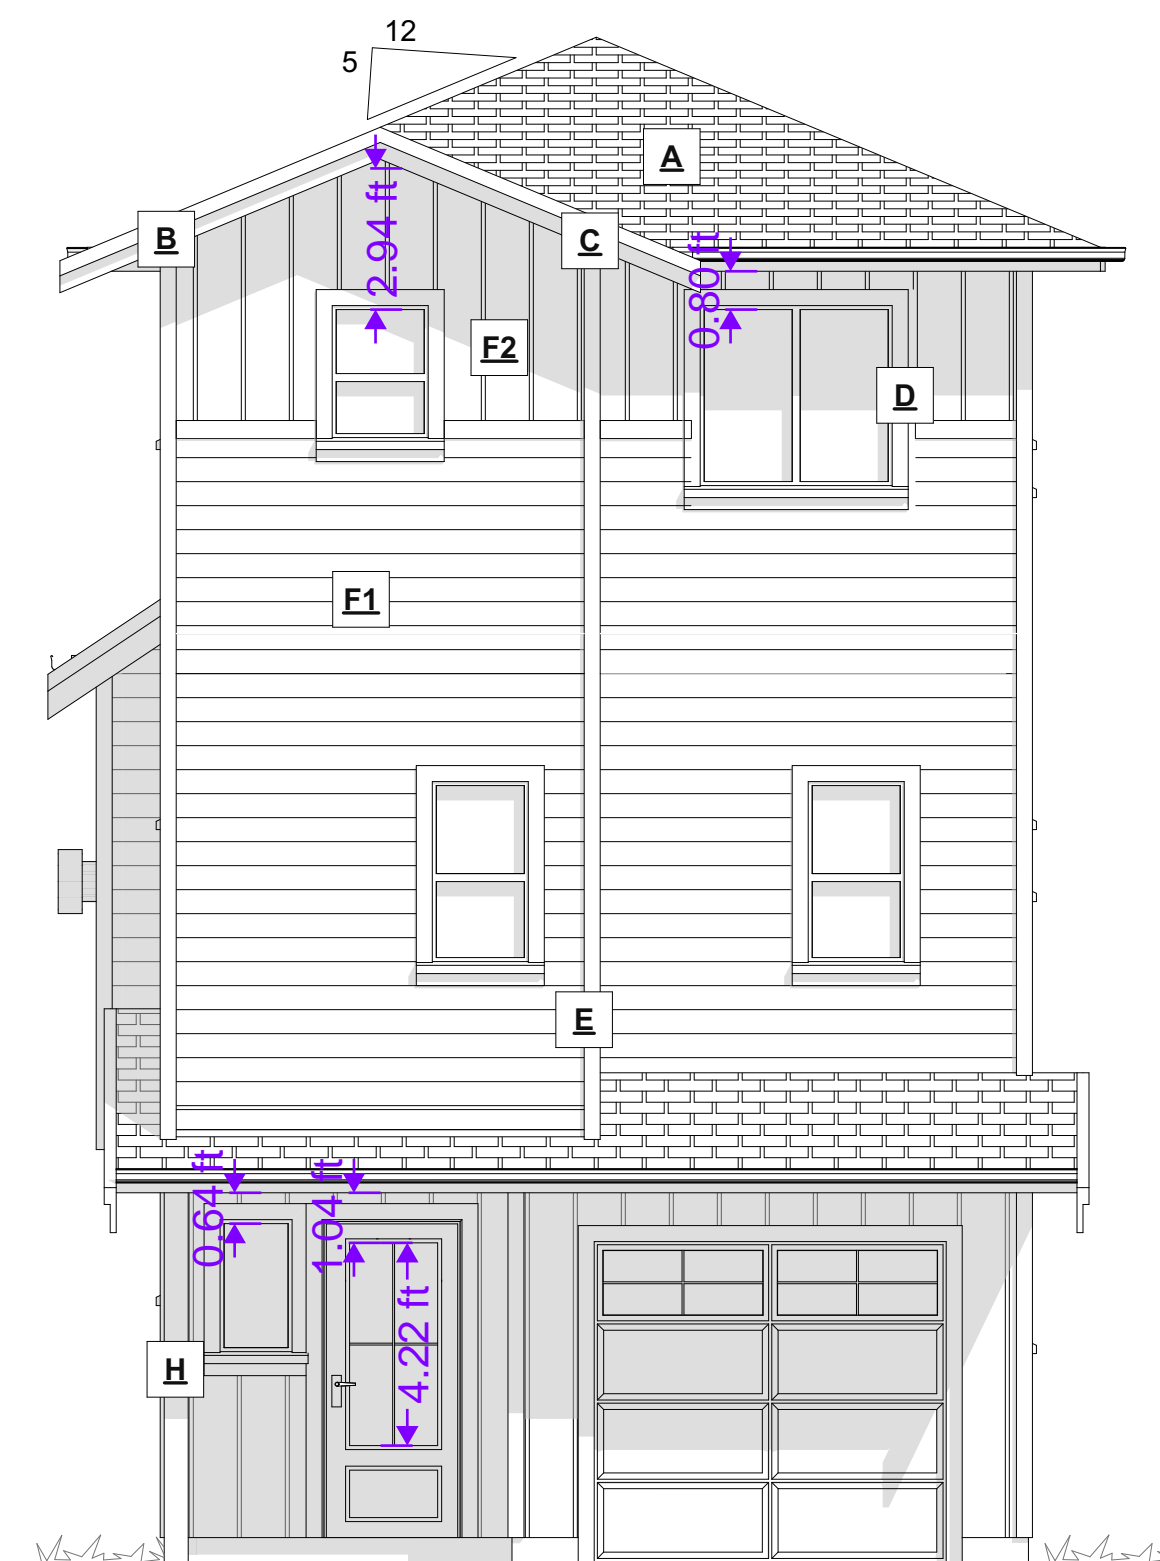


FRONT ELEVATION
SCALE: 1/4" = 1' - 0"

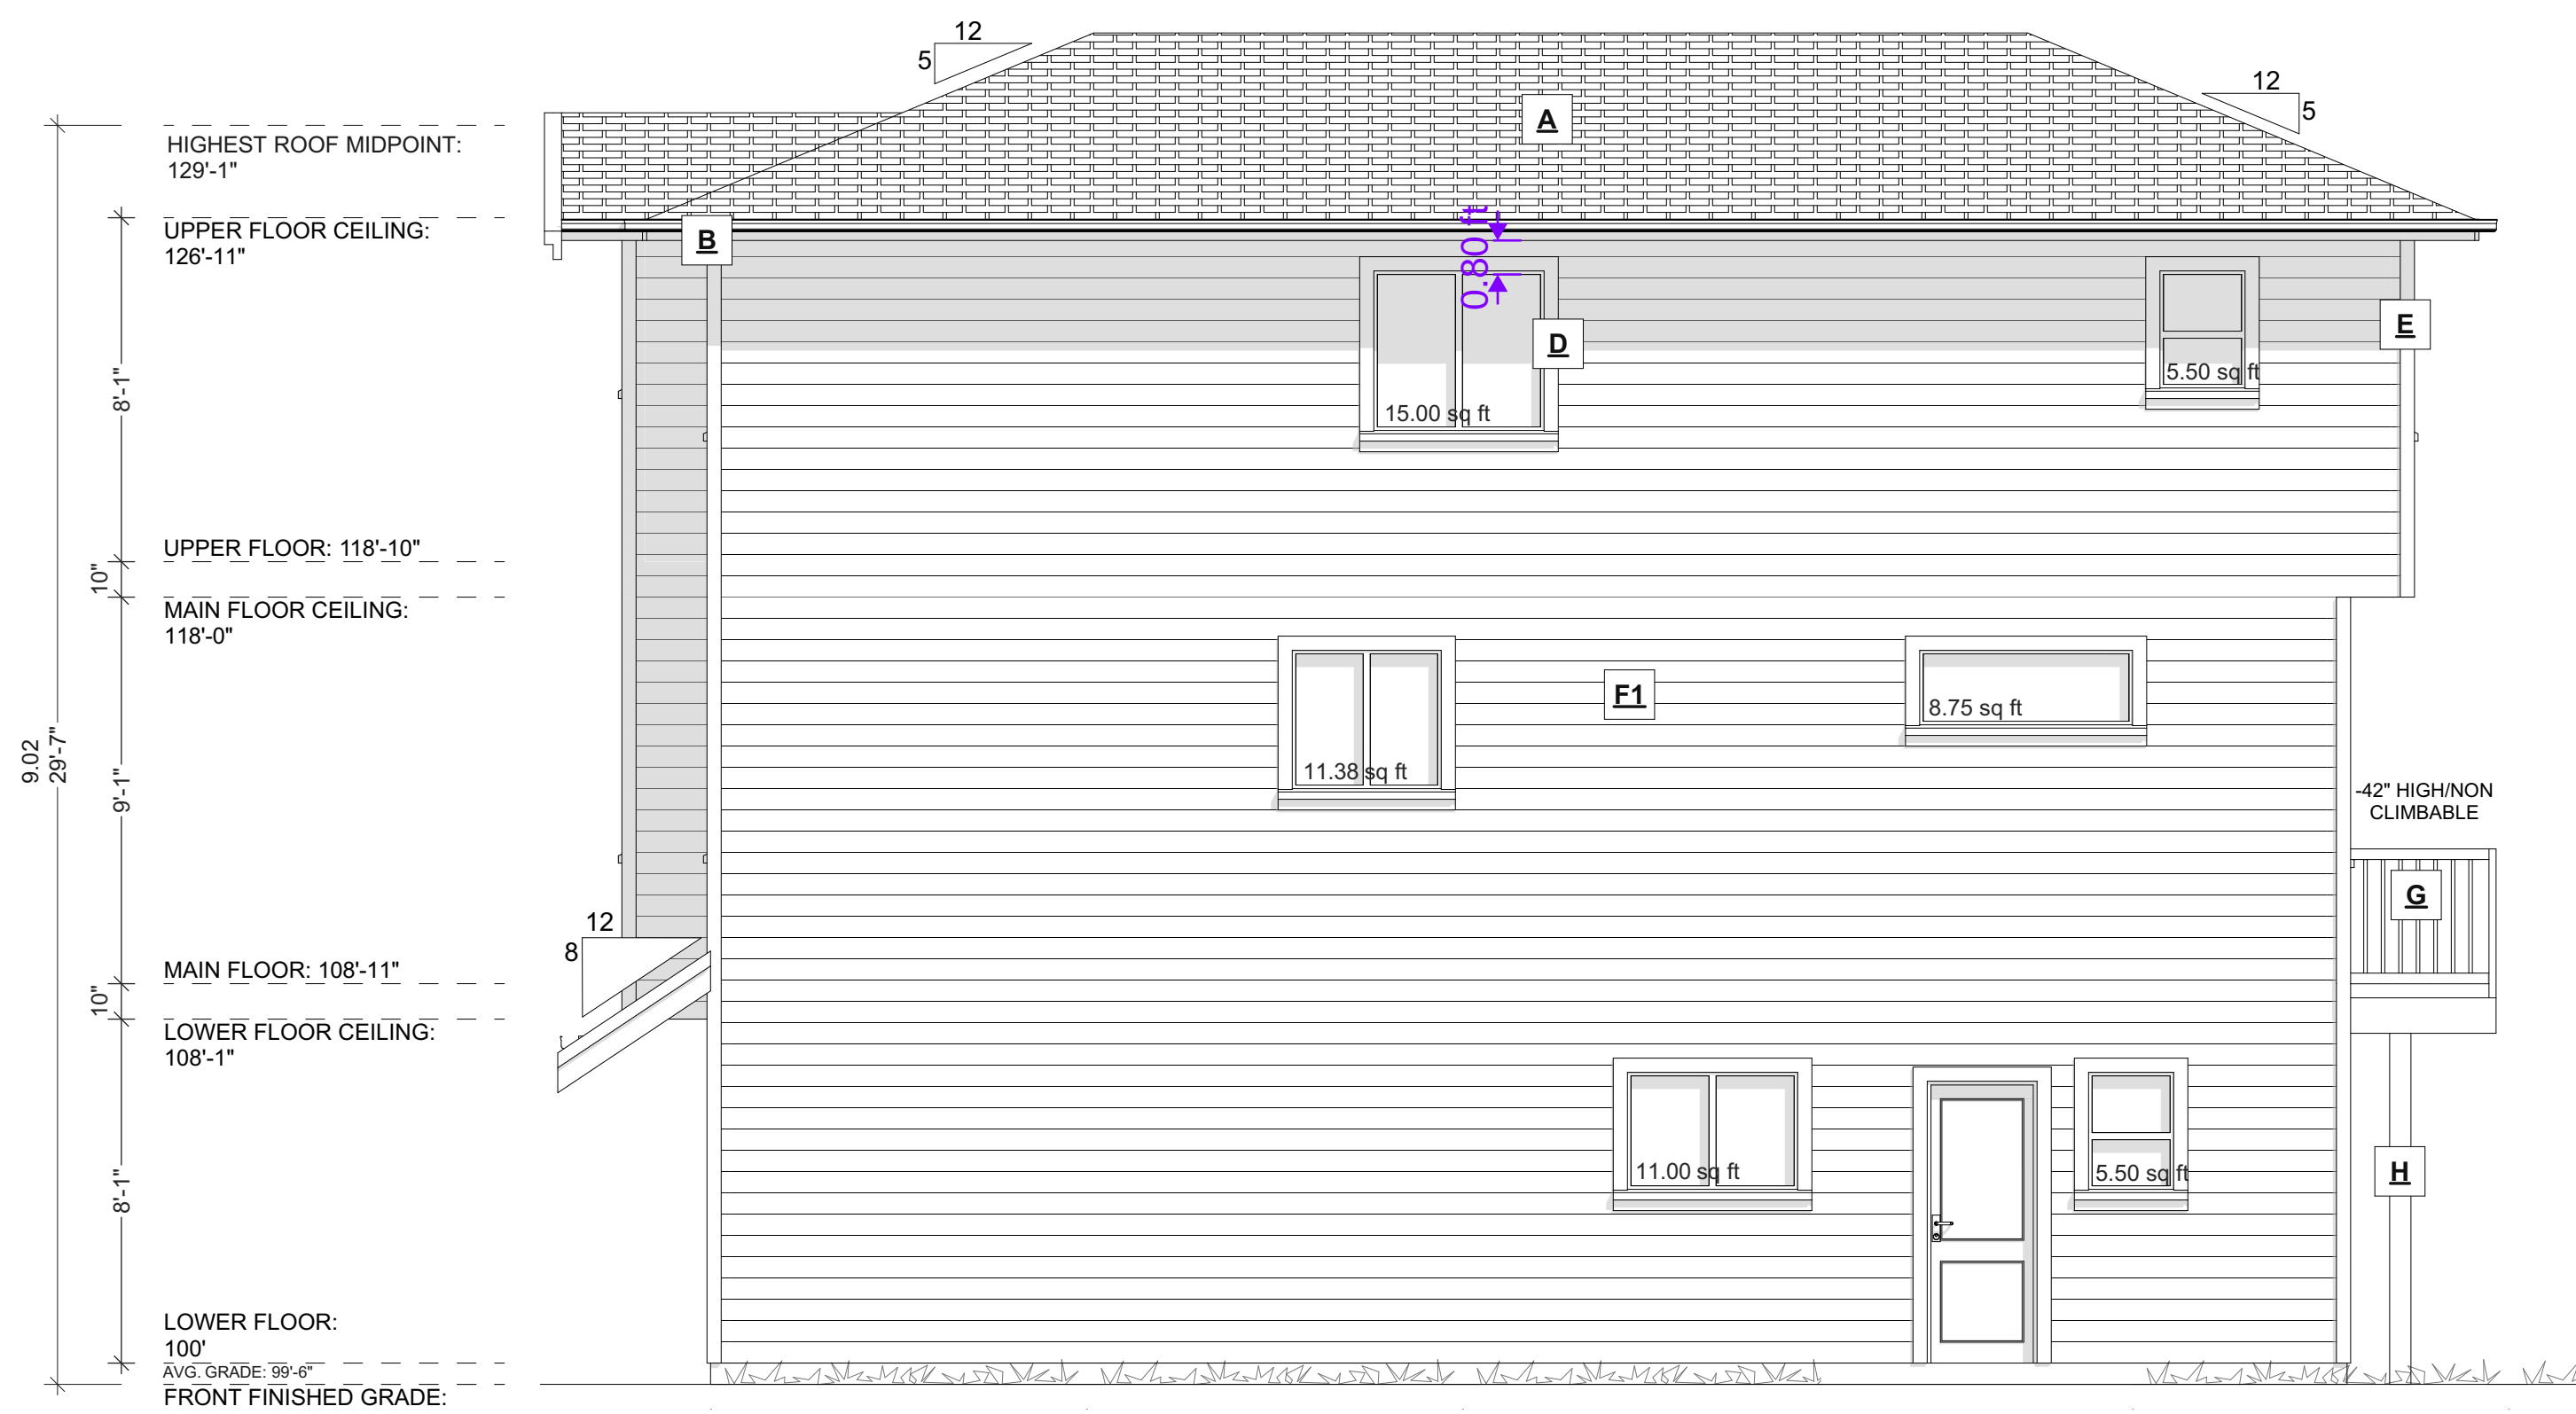


RIGHT ELEVATION
SCALE: 1/4" = 1' - 0"

EXPOSING BUILDING FACE: 96.67m²
LIMITING DISTANCE: 1.50m
AREA OF GLAZED OPENINGS: 5.31m²
% GLAZED OPENINGS: 5.49%
45 min FIRE-RESISTANCE RATING: not required
TYPE OF CLADDING: no limits
PERMITTED % OF GLAZED OPENINGS (as per Table 9.10.15.4): 8.00%
PERMITTED AGGREGATE AREA OF GLAZED OPENINGS: 7.73m²

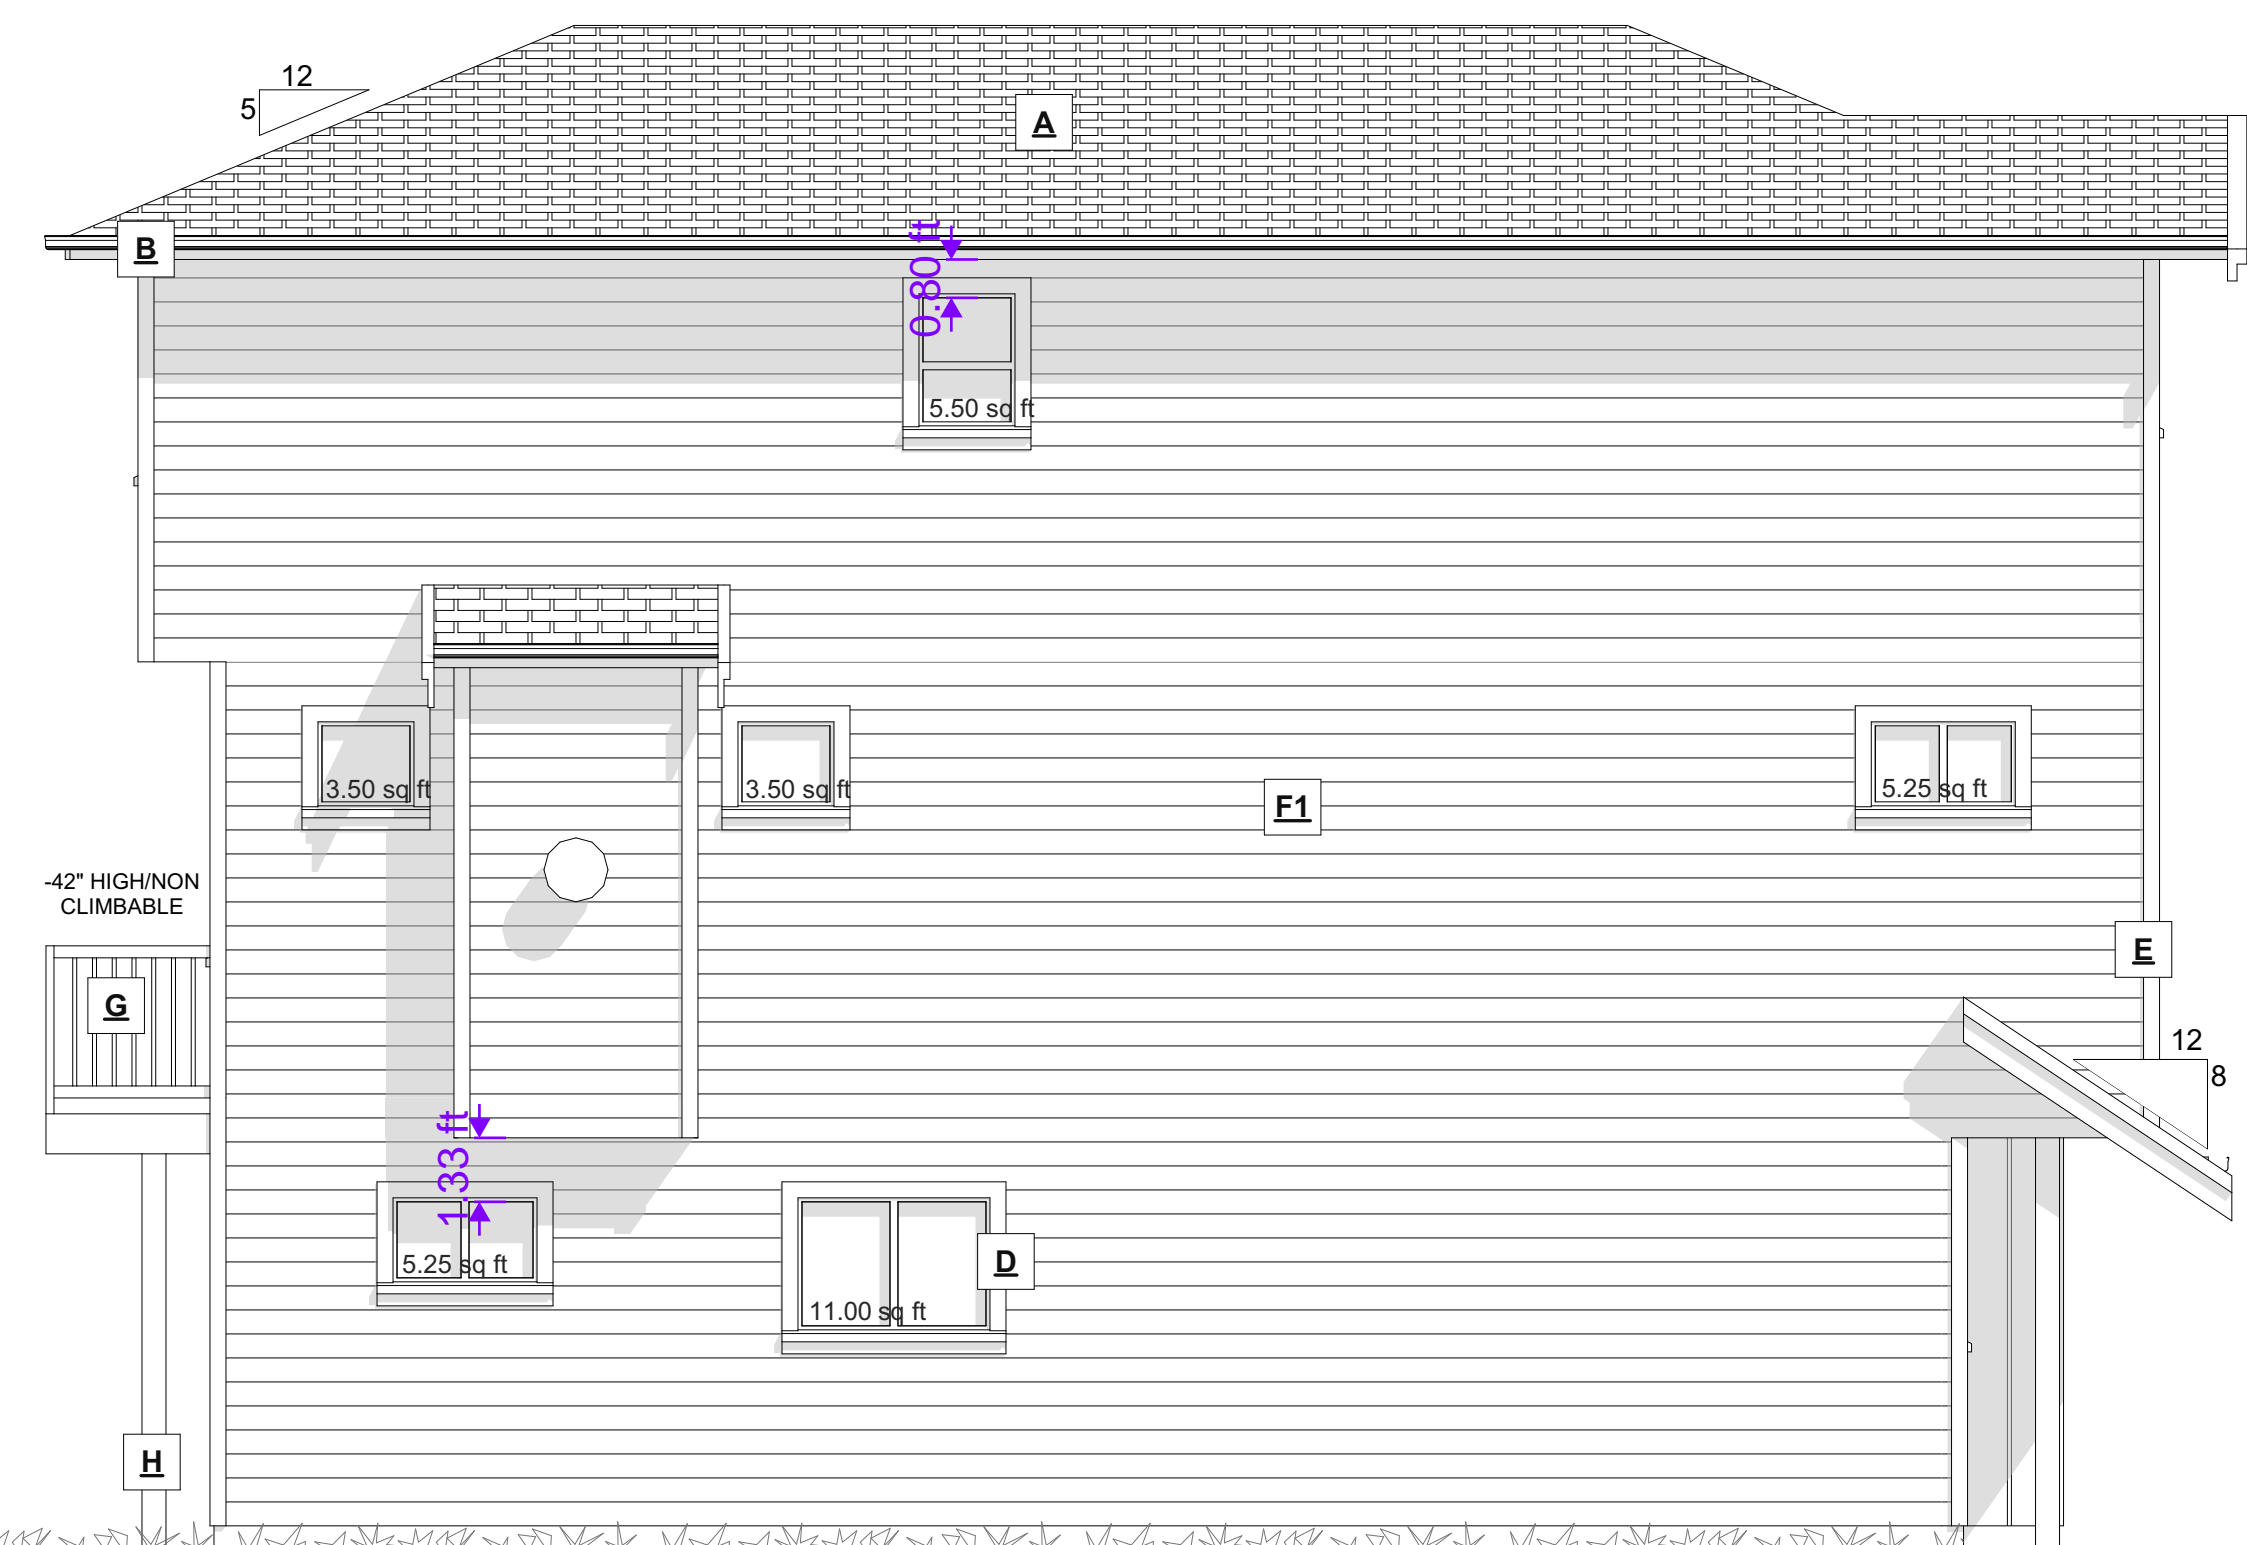


LEFT ELEVATION
SCALE: 1/4" = 1' - 0"

EXPOSING BUILDING FACE: 99.28m²
LIMITING DISTANCE: 1.50m
AREA OF GLAZED OPENINGS: 3.16m²
% GLAZED OPENINGS: 3.18%
45 min FIRE-RESISTANCE RATING: not required
TYPE OF CLADDING: no limits
PERMITTED % OF GLAZED OPENINGS (as per Table 9.10.15.4): 8.00%
PERMITTED AGGREGATE AREA OF GLAZED OPENINGS: 7.94m²

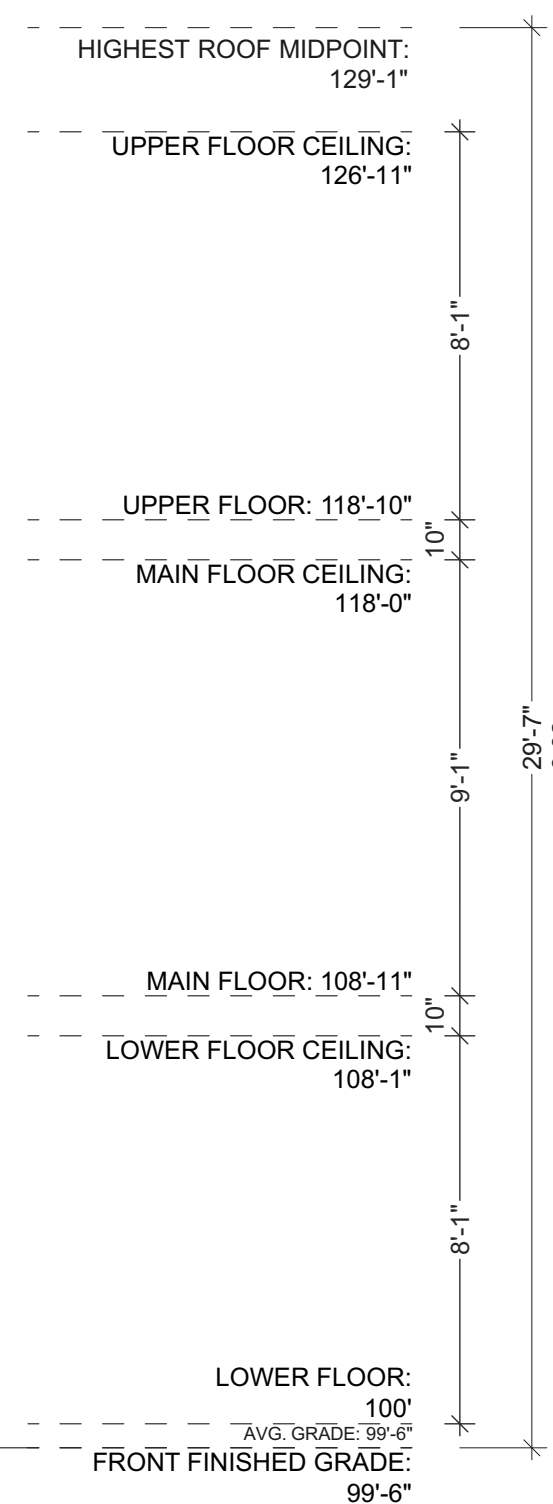

EXTERIOR FINISHES SCHEDULE		
A	ROOFING:	ASPHALT ROOFING WITH RAISED RIDGE & HIP CAPS
B	GUTTER & SOFFIT:	ALUMINIUM GUTTER AND NON-VENTED SOFFIT
C	BARGE BOARD:	2x10 WITH 1x4 DOUBLE BARGE BOARD, PAINTED TRIM COLOUR
D	WINDOW & DOOR TRIM:	1x4 TRIM BOARDS - PAINTED/STAINED
E	CORNER TRIM:	1x4 CORNER BOARDS - PAINTED/STAINED
F1	WALL FINISH:	HARDIE-PLANK SIDING LAPPED TO 6" EXPOSURE -COLOUR AS PER OWNERS SPECS
F2	WALL FINISH:	HARDIE-BOARD AND BATTEN 1x4 @ 16" O.C. -RAINSREEN AS PER BCBC
F3	WALL FINISH:	HARDIE SHAKES - PAINTED/FINISH -COLOUR AS PER OWNERS SPECS -RAINSREEN AS PER BCBC
G	RAILING:	42" HIGH/NON CLIMBABLE
H	POSTS:	POSTS - PAINTED/STAINED AS PER OWNERS SPECS

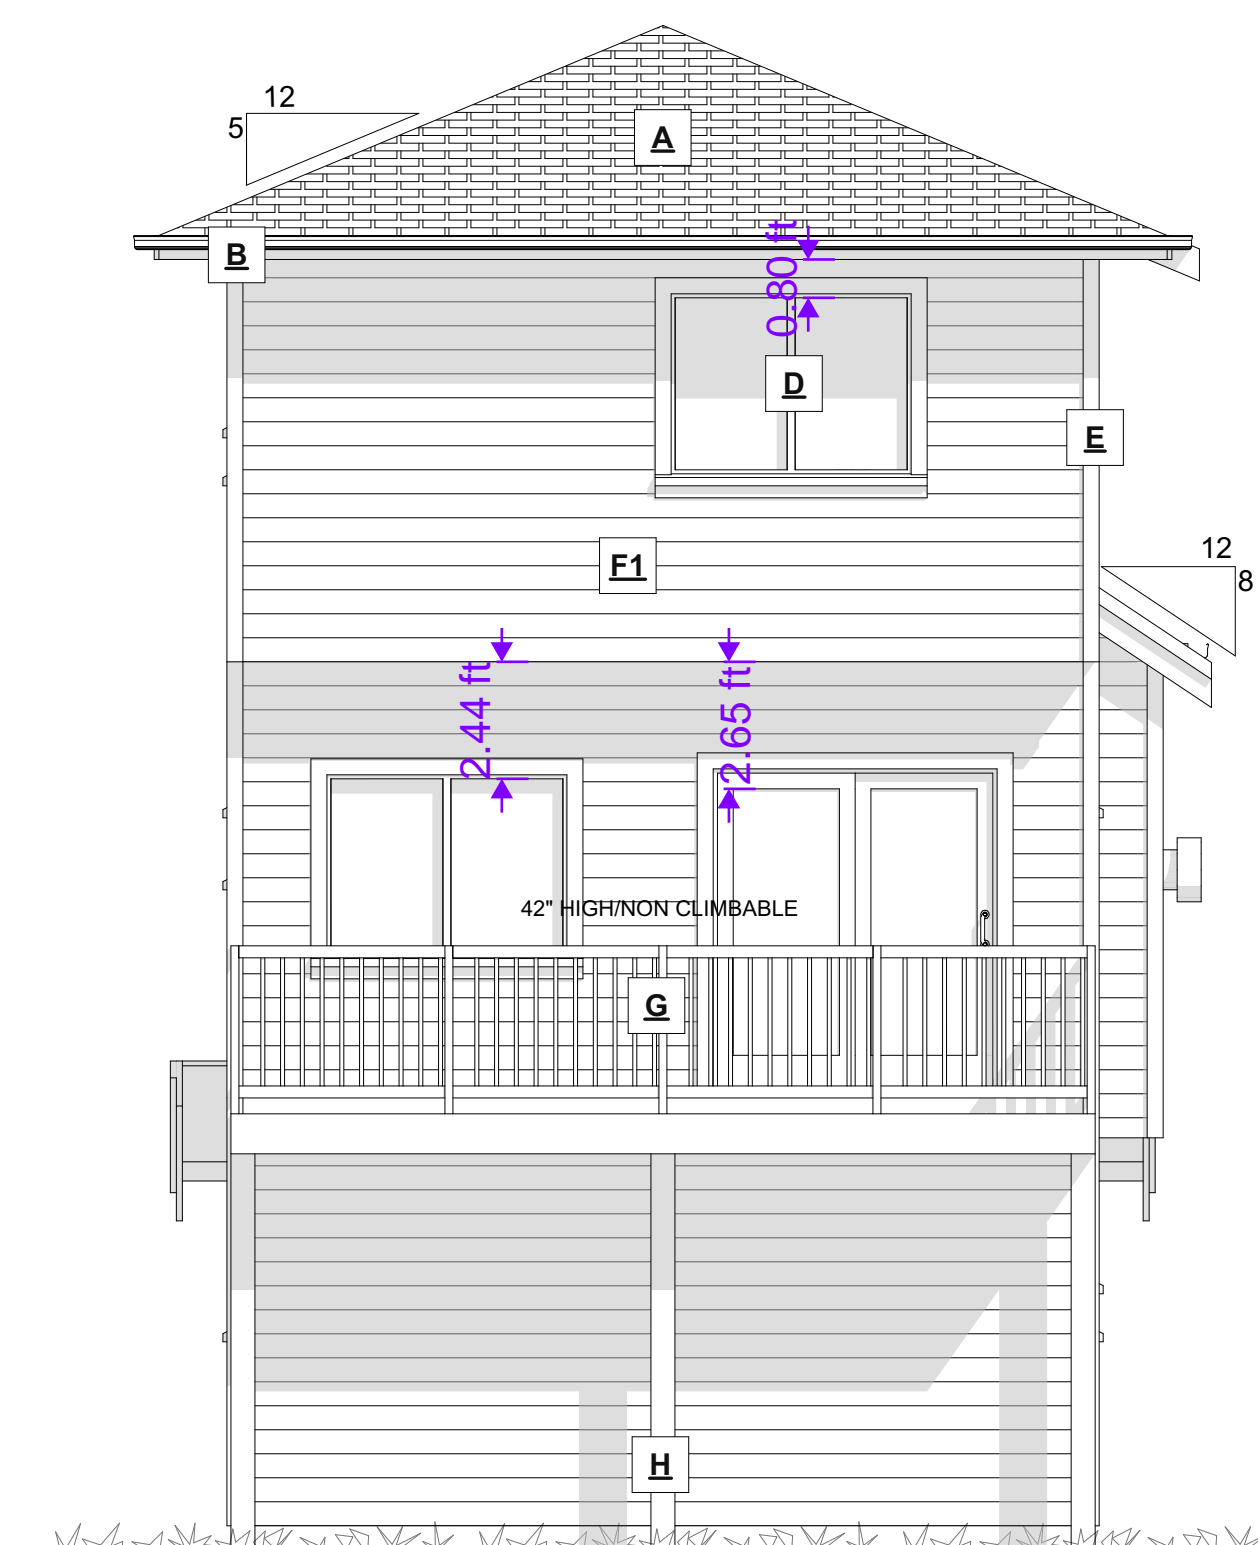

REAR ELEVATION
SCALE: 1/4" = 1' - 0"

ADDRESS:
SL 10 - 924 ROSEFINCH PLACE,
LANGFORD
CUSTOMER:
TEKLOCH HOMES LTD.

DRAWING NAME:
ELEVATIONS
DRAWING SCALE:
1/4"=1'-0" / SEE DRAWINGS


ISSUE DATE:
FEB 20, 2025
DRAWN BY:
LS
CHECKED BY:
KL

102 - 2871 JACKLIN ROAD
VICTORIA BC V9B 0P3
JAVADESIGN.CA
250.590.2468




SHEET NUMBER


A4

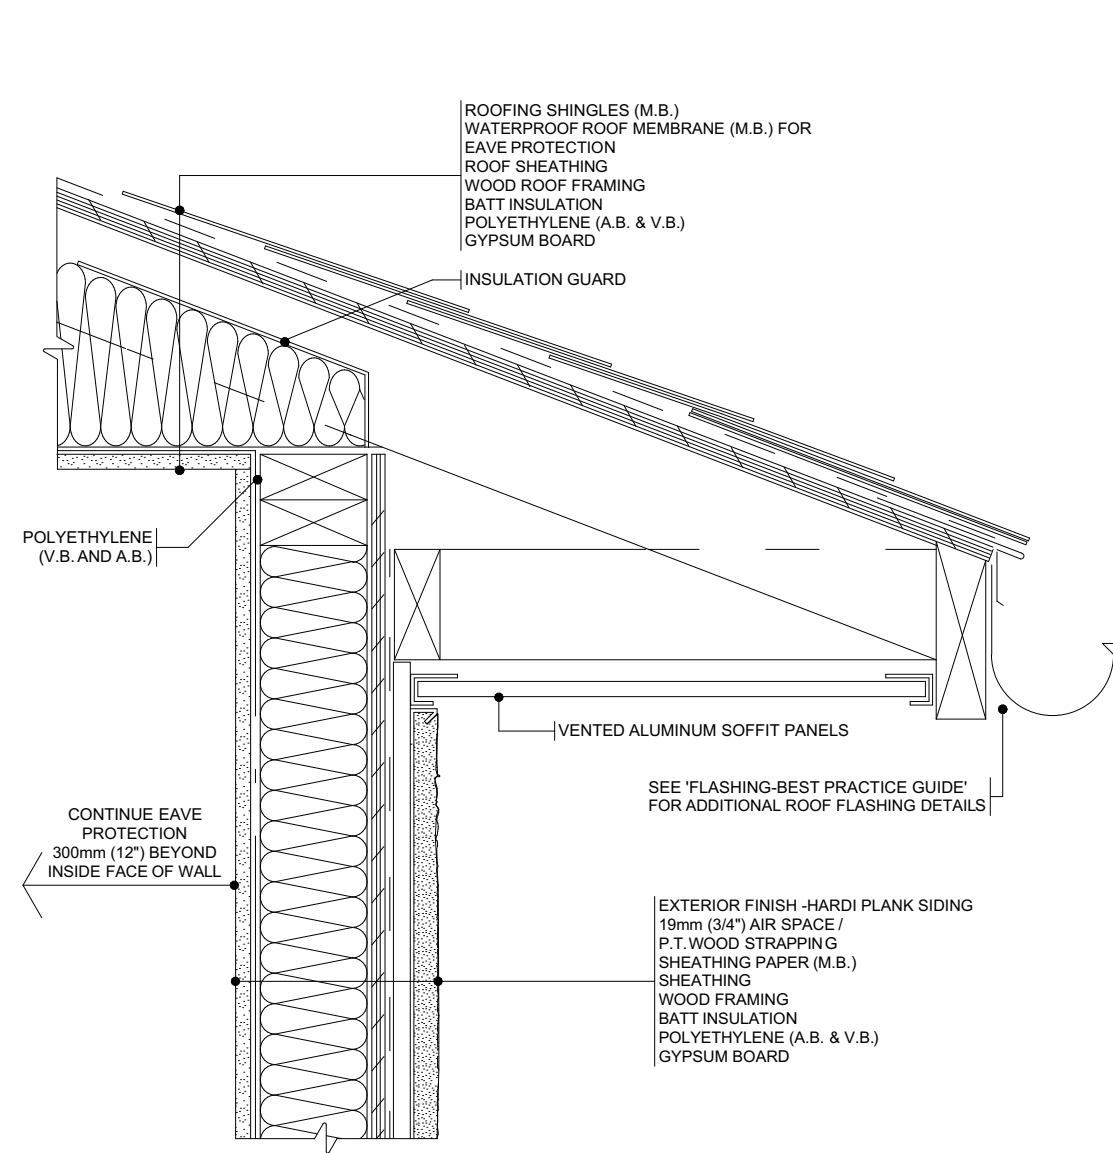


5 SPA
WATER SHEDDING ROOF / WALL SEALED POLYETHYLENE APPROACH
BEST PRACTICE GUIDE

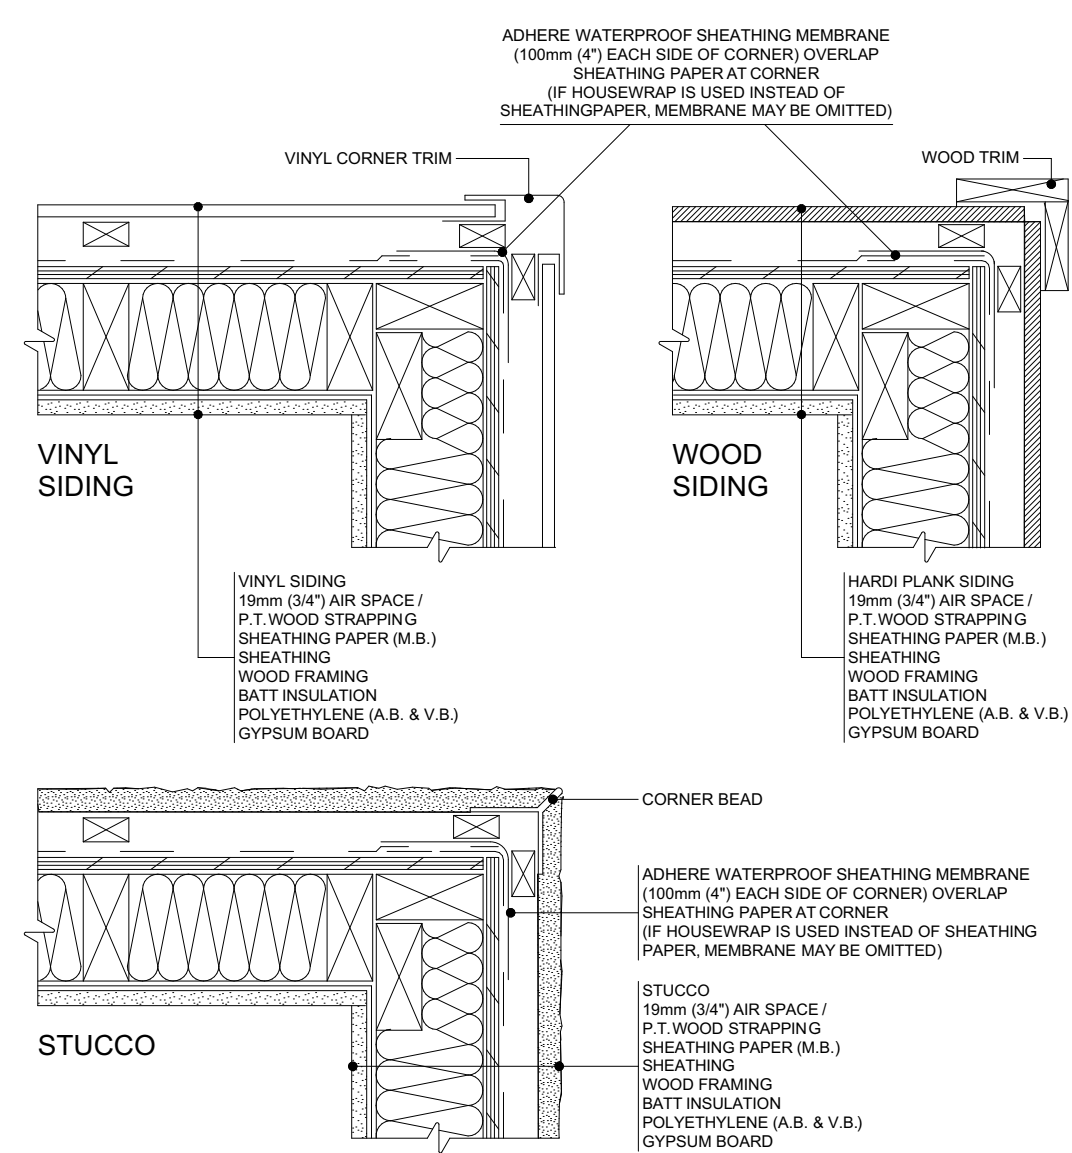


8 SPA
EXTERIOR CORNER SEALED POLYETHYLENE APPROACH
BEST PRACTICE GUIDE

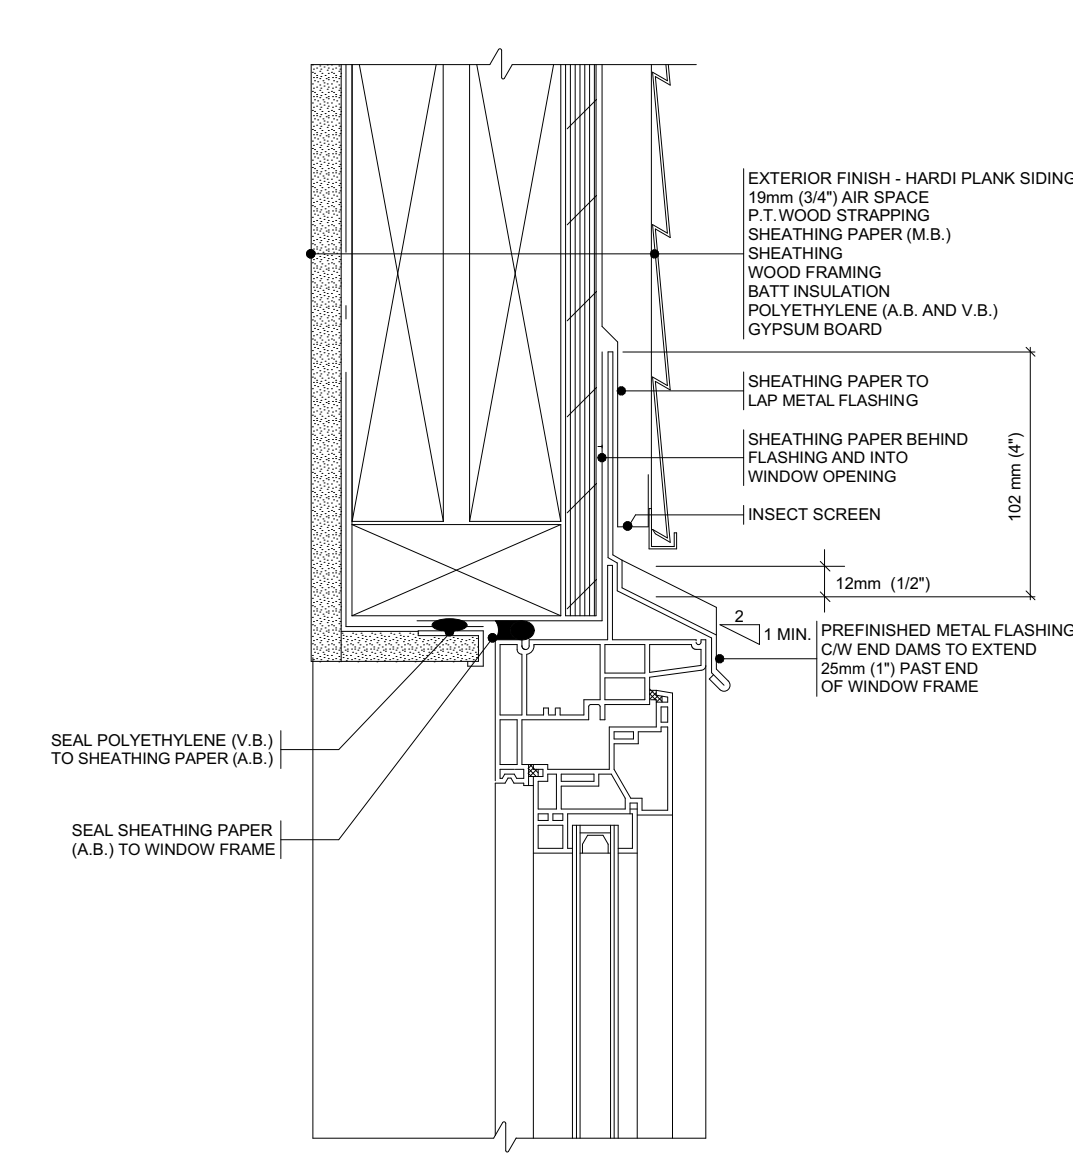


11 SPA
WINDOW HEAD SEALED POLYETHYLENE APPROACH
BEST PRACTICE GUIDE

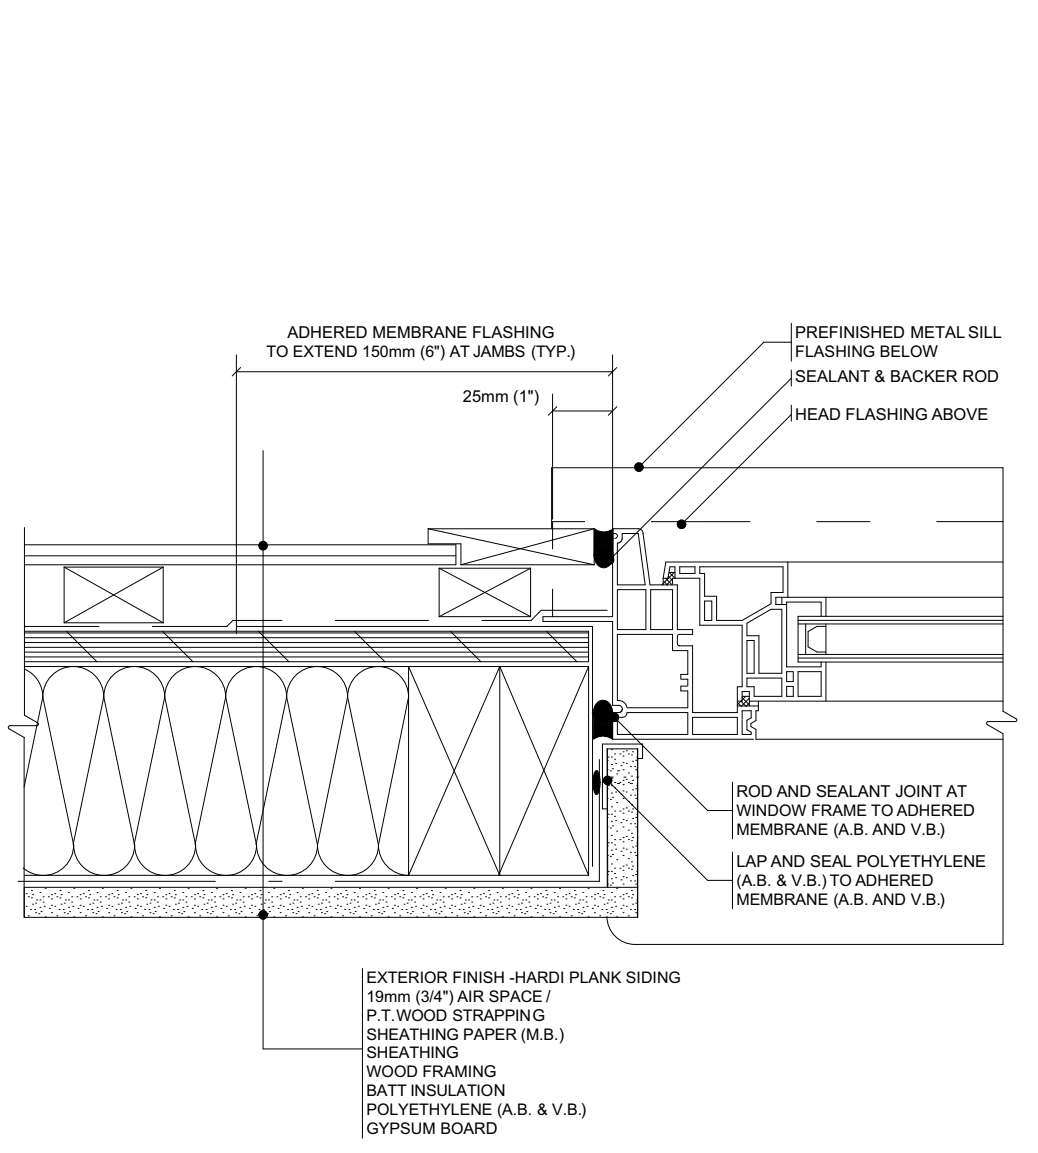


12 SPA
WINDOW JAMB SEALED POLYETHYLENE APPROACH
BEST PRACTICE GUIDE

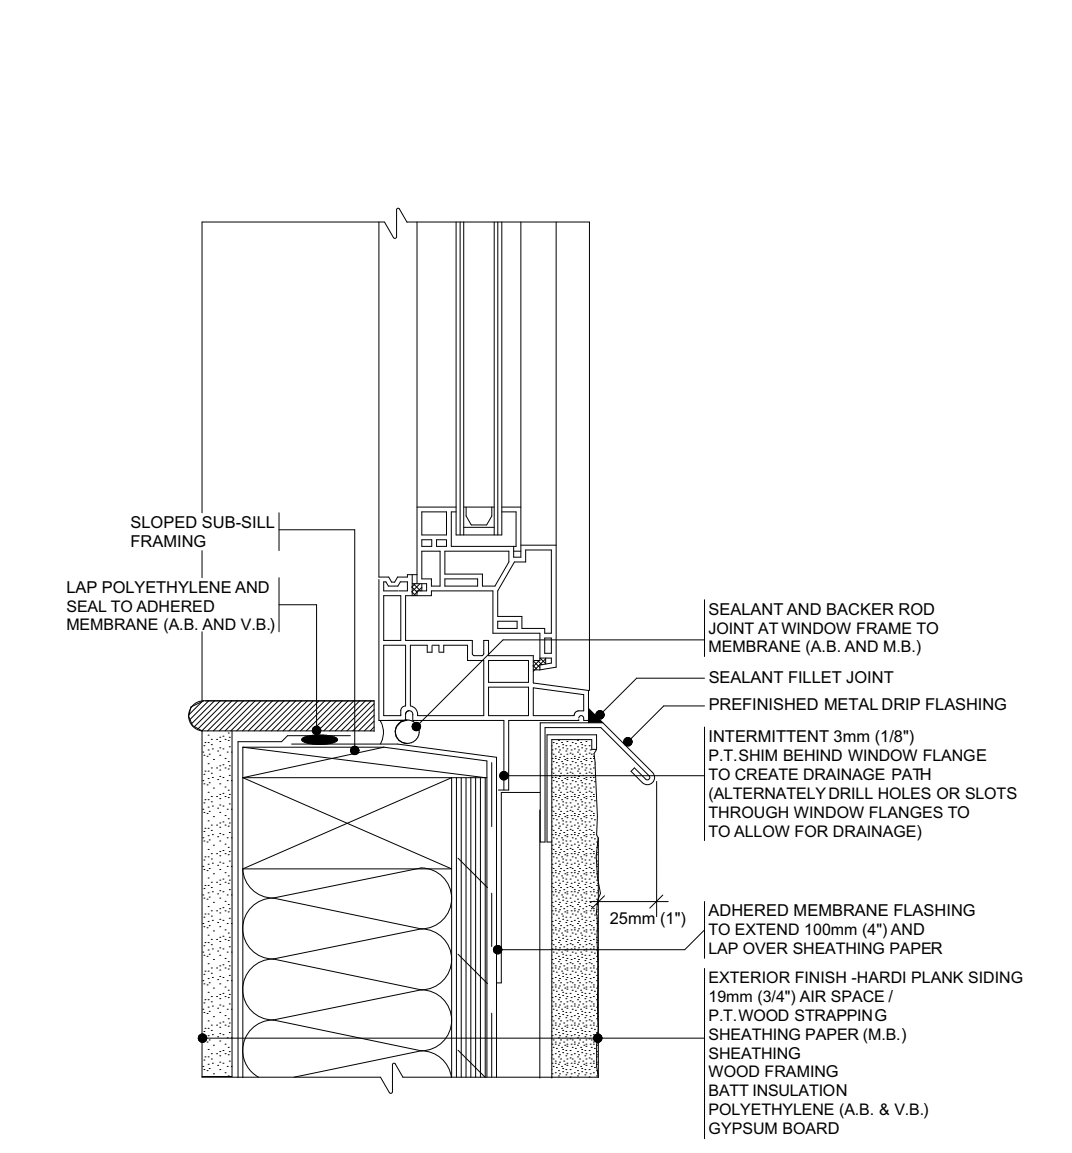


13 SPA
WINDOW SILL SEALED POLYETHYLENE APPROACH
BEST PRACTICE GUIDE

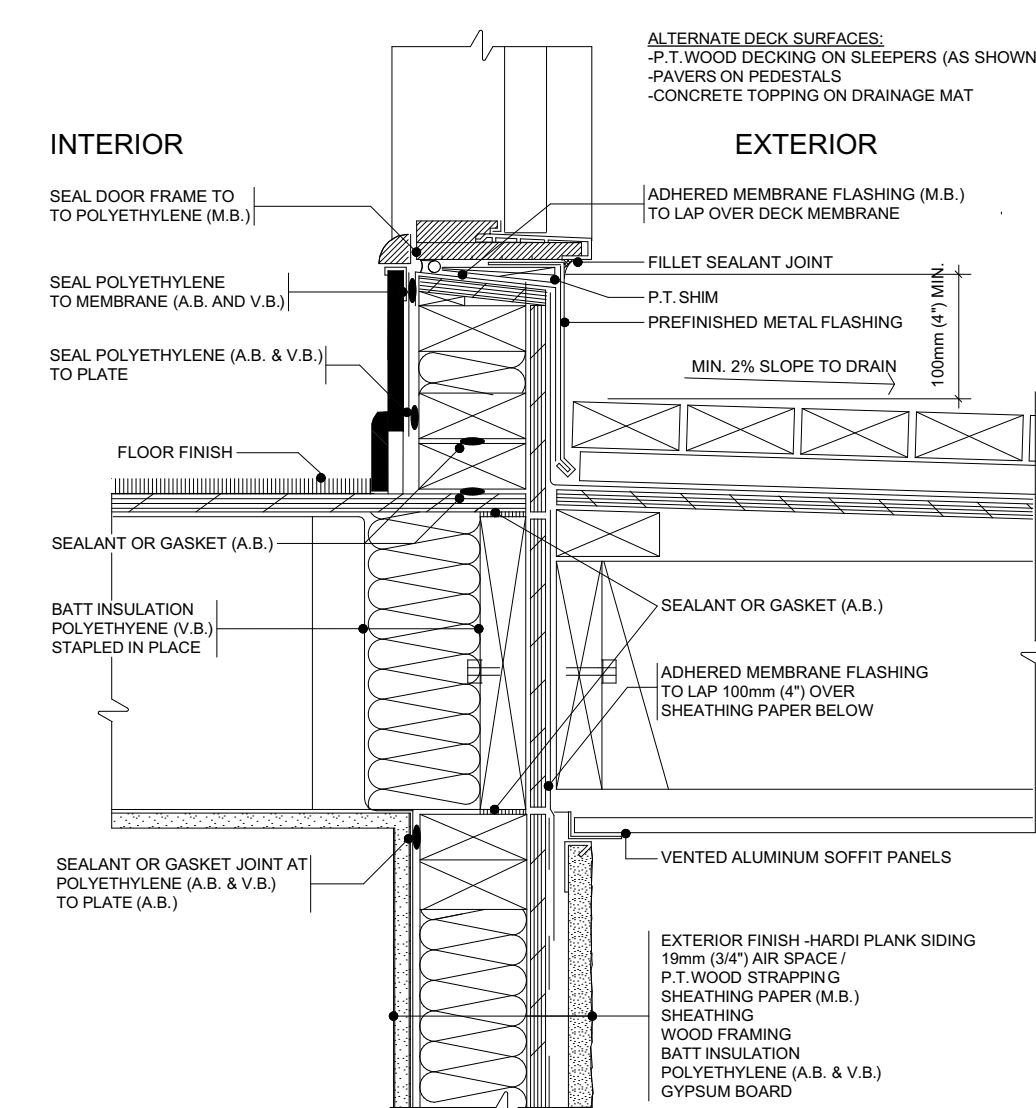


14 SPA
DOOR SILL - EXPOSED MEMBRANE PEDESTRIAN SURFACE SEALED POLYETHYLENE APPROACH
BEST PRACTICE GUIDE

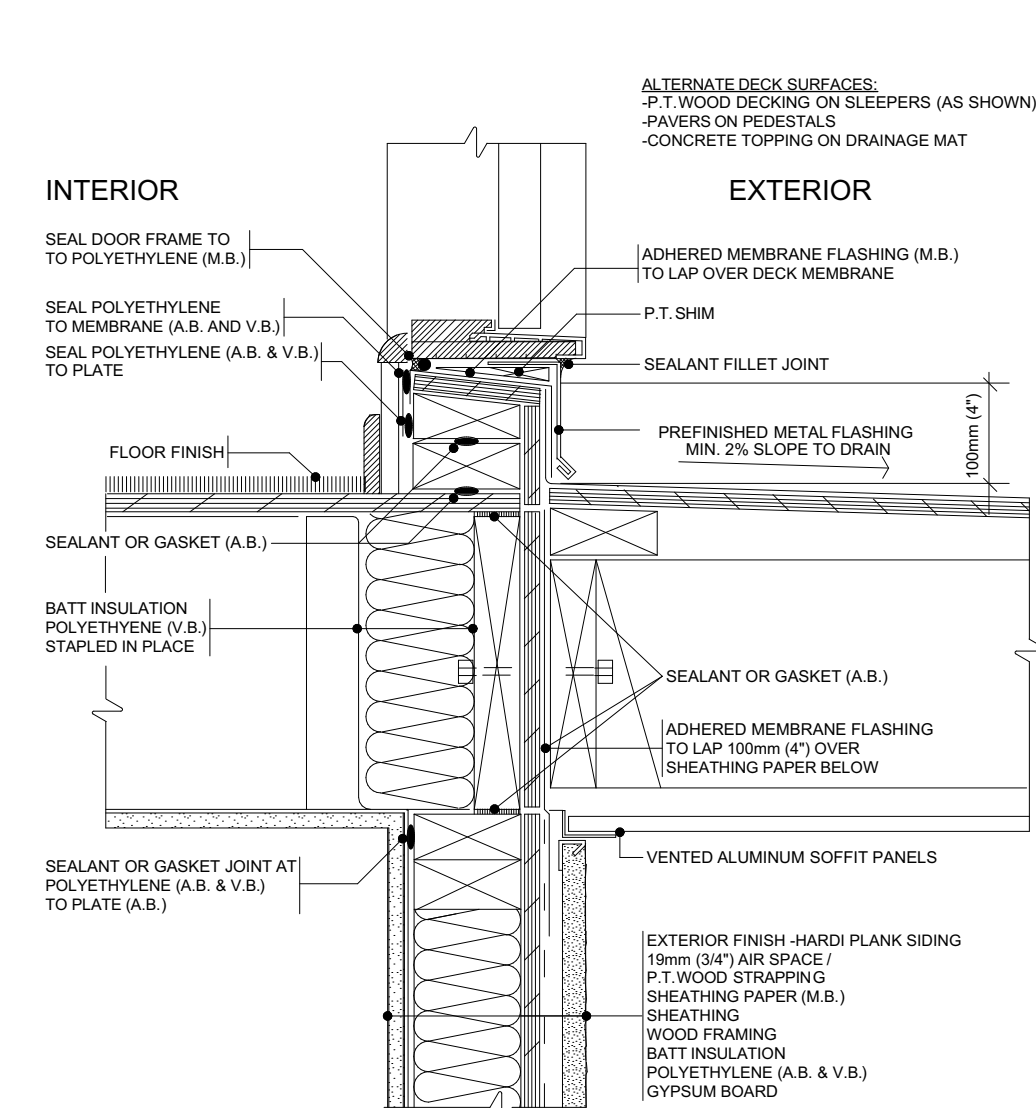


15 SPA
DOOR SILL - EXPOSED MEMBRANE PEDESTRIAN SURFACE SEALED POLYETHYLENE APPROACH
BEST PRACTICE GUIDE

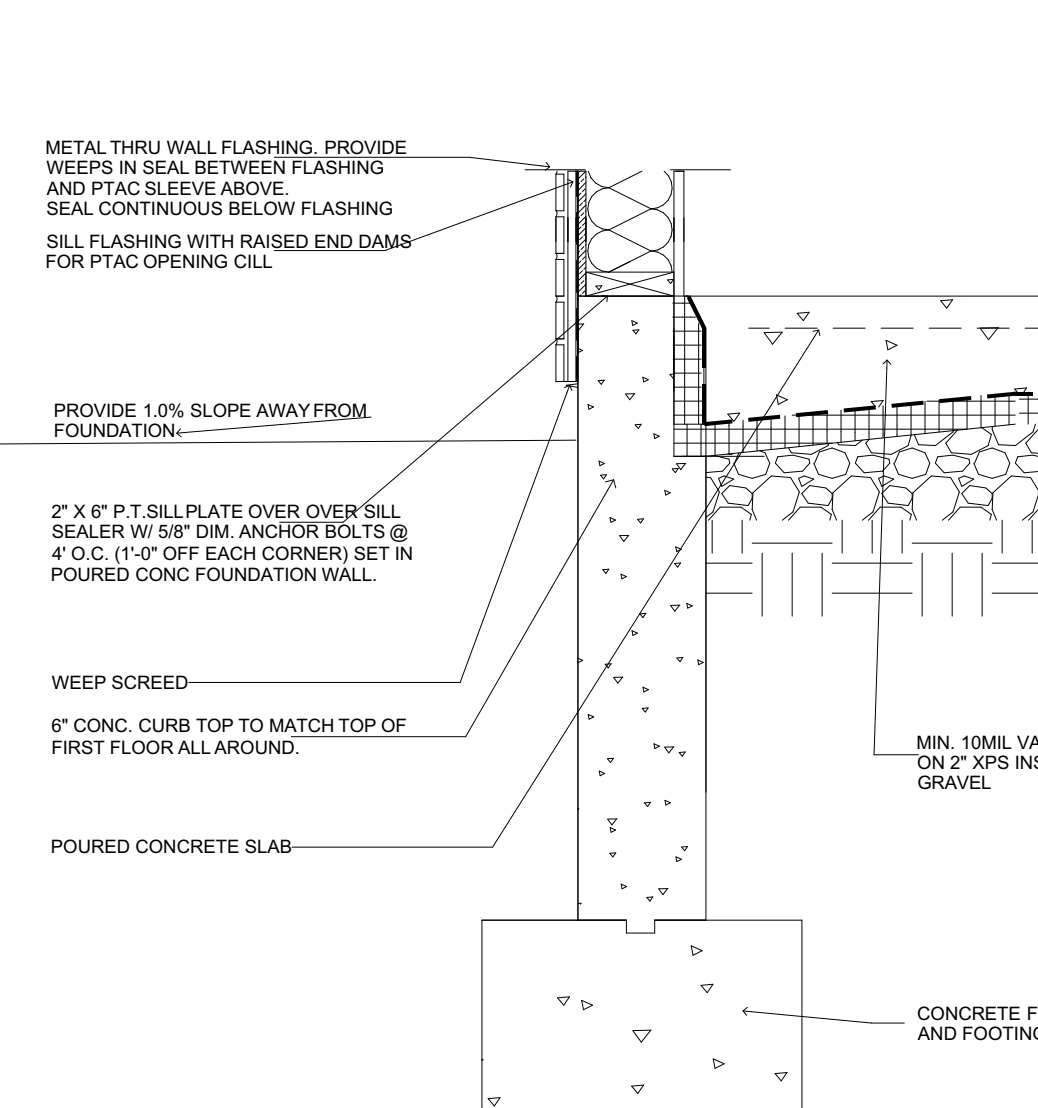


23
EXTERIOR ELEMENT - COLUMN
BEST PRACTICE GUIDE

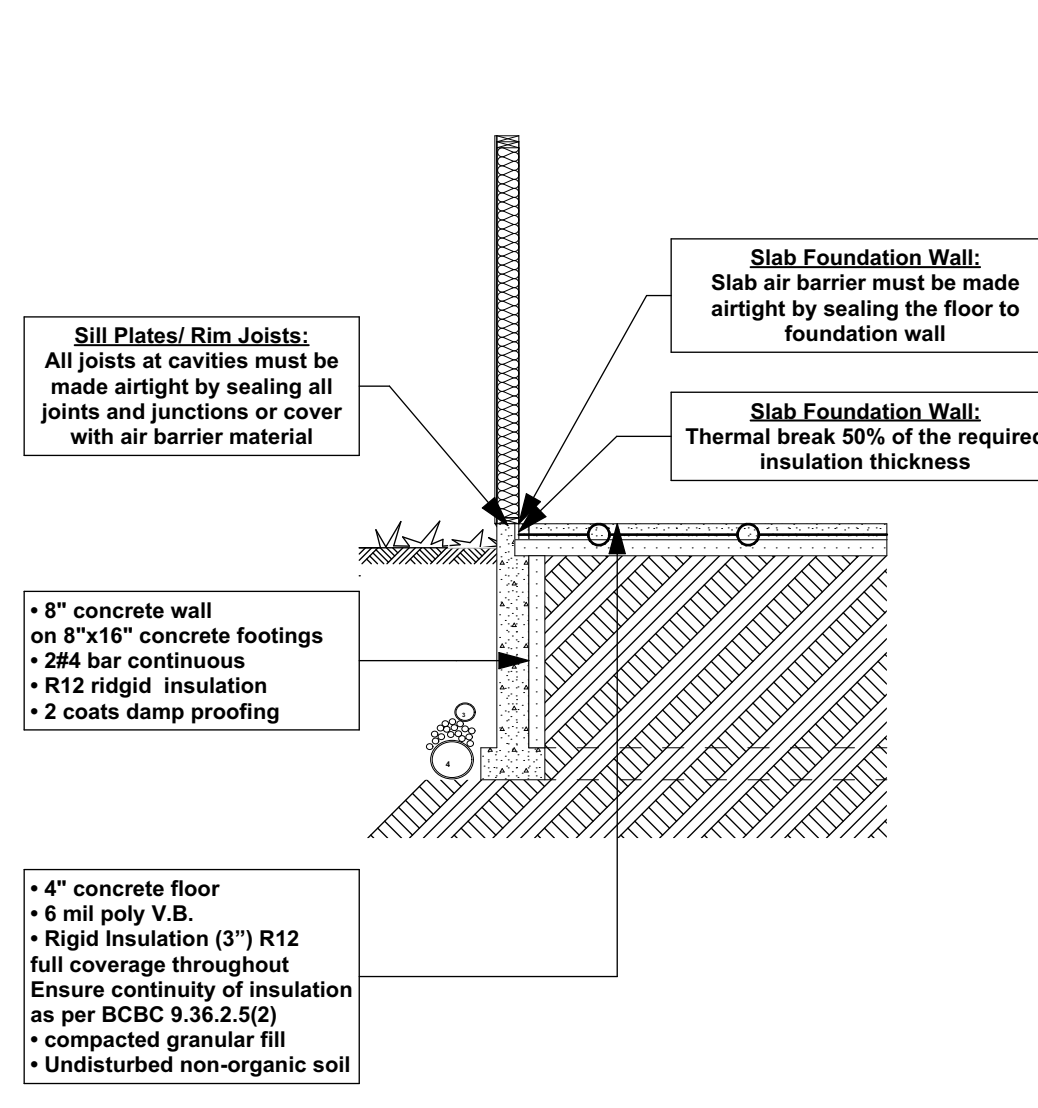


27 SPA
WALL EXHAUST VENT SEALED POLYETHYLENE APPROACH
BEST PRACTICE GUIDE

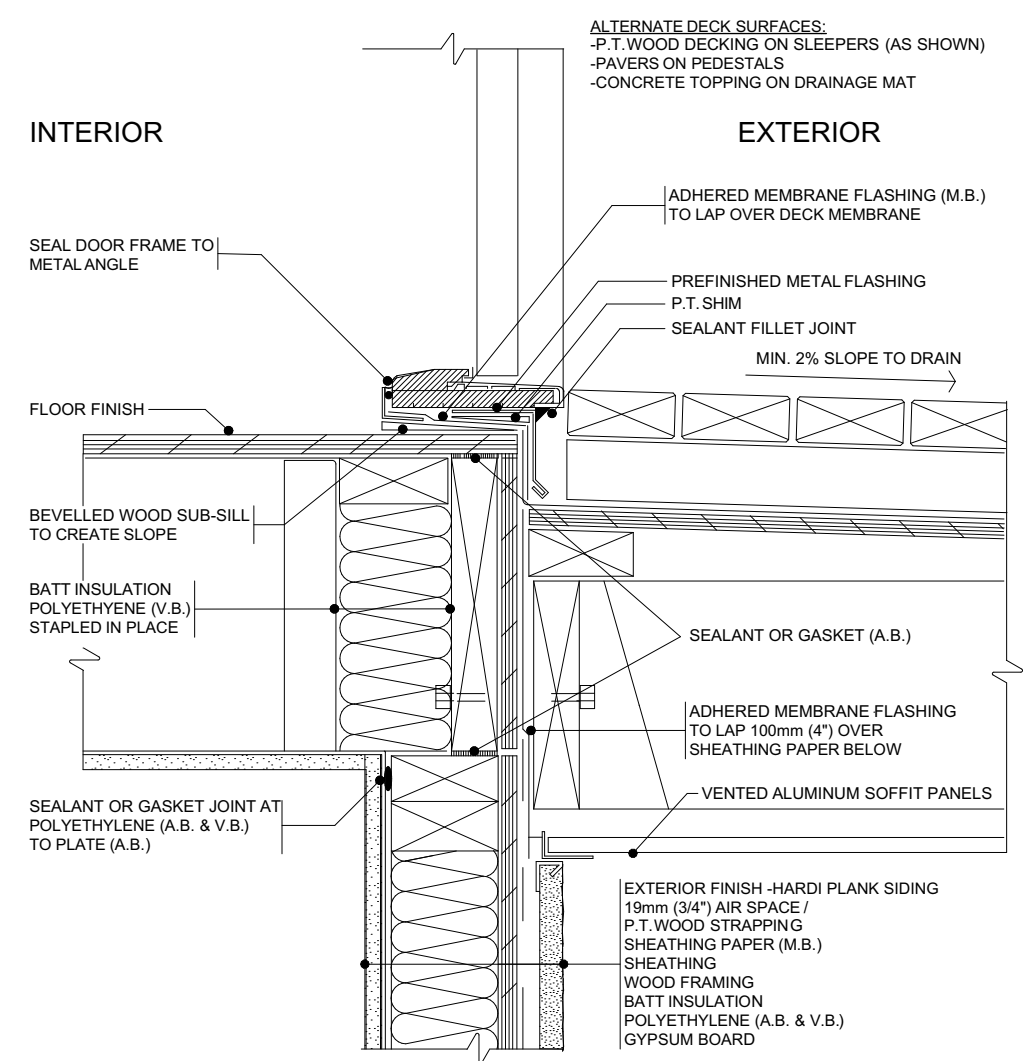


16 SPA
ACCESSIBLE DOOR SILL - EXPOSED MEMBRANE PEDESTRIAN SURFACE SEALED POLYETHYLENE APPROACH
BEST PRACTICE GUIDE

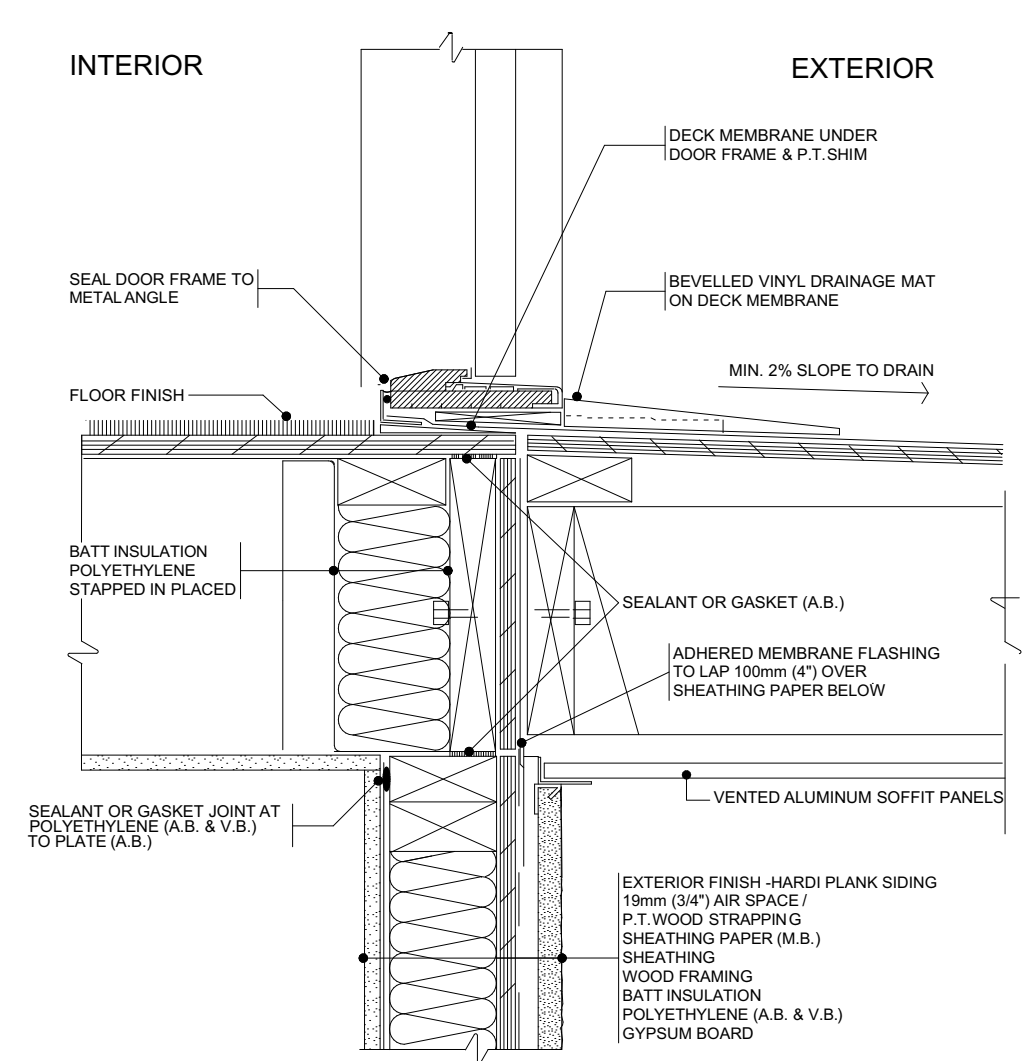

17 SPA
ACCESSIBLE DOOR SILL - EXPOSED MEMBRANE PEDESTRIAN SURFACE SEALED POLYETHYLENE APPROACH
BEST PRACTICE GUIDE

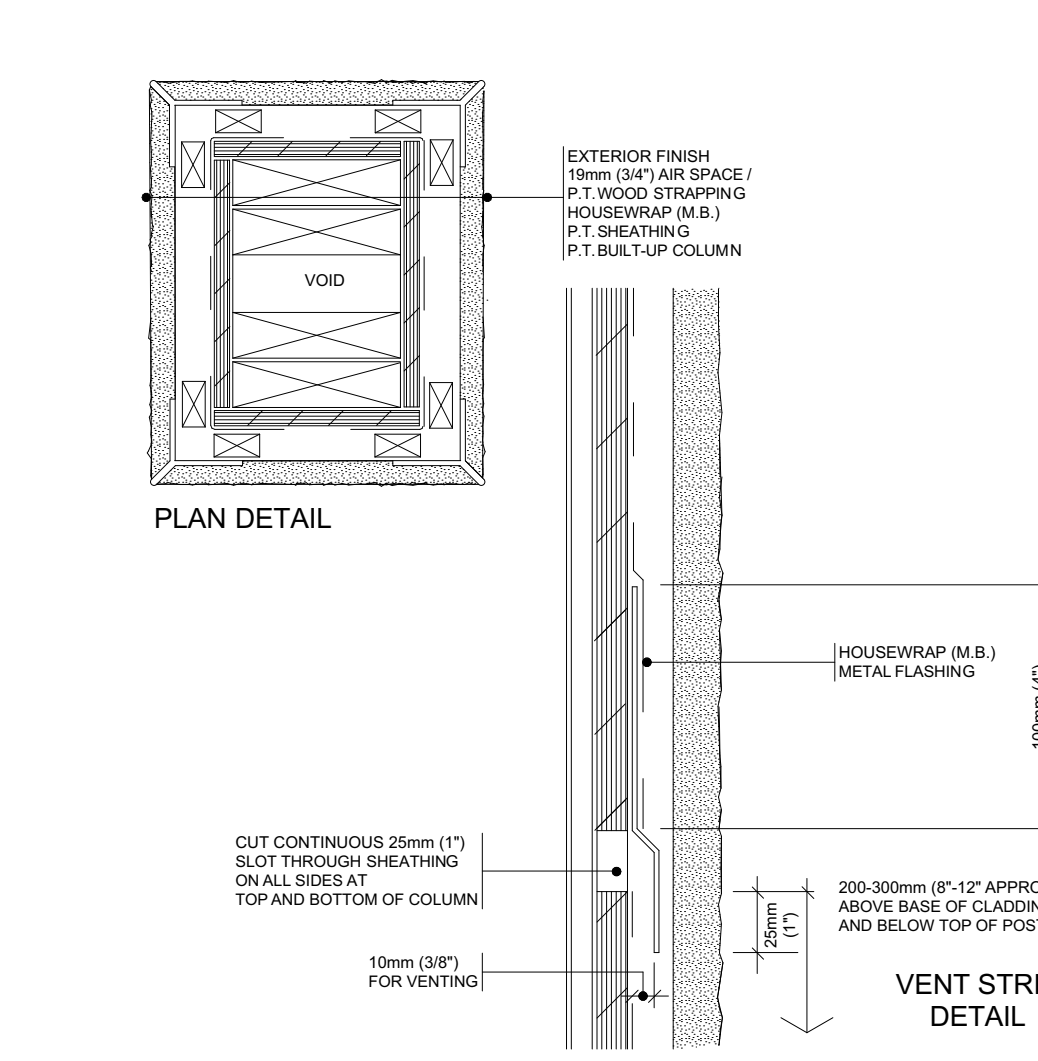

23
EXTERIOR ELEMENT - COLUMN
BEST PRACTICE GUIDE

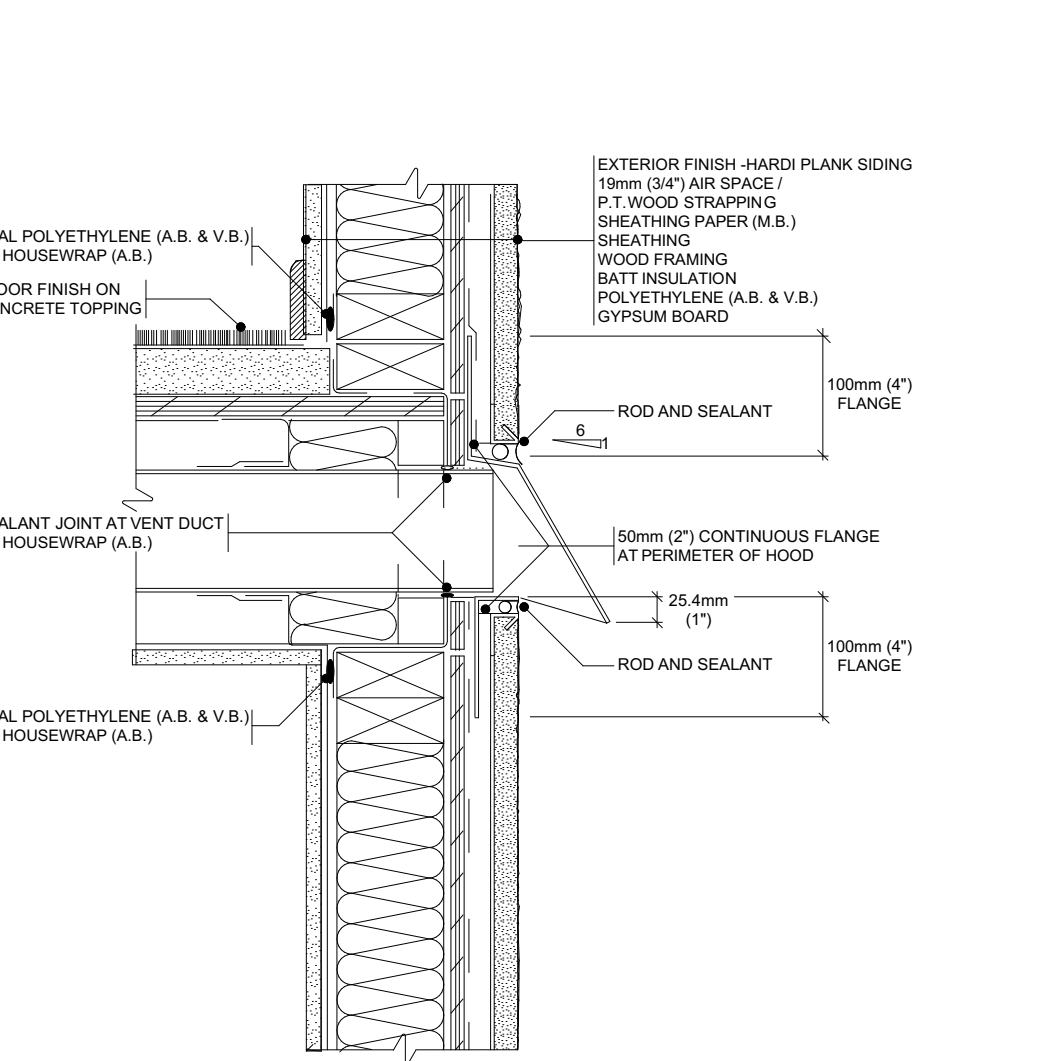

27 SPA
WALL EXHAUST VENT SEALED POLYETHYLENE APPROACH
BEST PRACTICE GUIDE

ADDRESS:
SL 10 - 924 ROSEFINCH PLACE,
LANGFORD
CUSTOMER:
TEKLOCH HOMES LTD.

DRAWING NAME:
DETAILS
DRAWING SCALE:
SEE DRAWINGS

ISSUE DATE:
FEB 20, 2025
DRAWN BY:
LS
CHECKED BY:
KL

102 - 2871 JACKLIN ROAD
VICTORIA BC V9B 0P3
JAVADESIGNS.CA
250.590.2468

JAVA DESIGNS

SHEET NUMBER

D1

LEVEL 2 FULL PASSIVE VERTICAL RADON STACK SYSTEM REQUIRED WHICH CONFORMS TO THE "RADON CONTROL OPTIONS FOR NEW CONSTRUCTION IN LOW-RISE RESIDENTIAL BUILDINGS" DOCUMENT FROM THE GOVERNMENT OF CANADA CAN/CGSB-149.11-2019 REFER TO DOCUMENT FOR SPECIFICATIONS

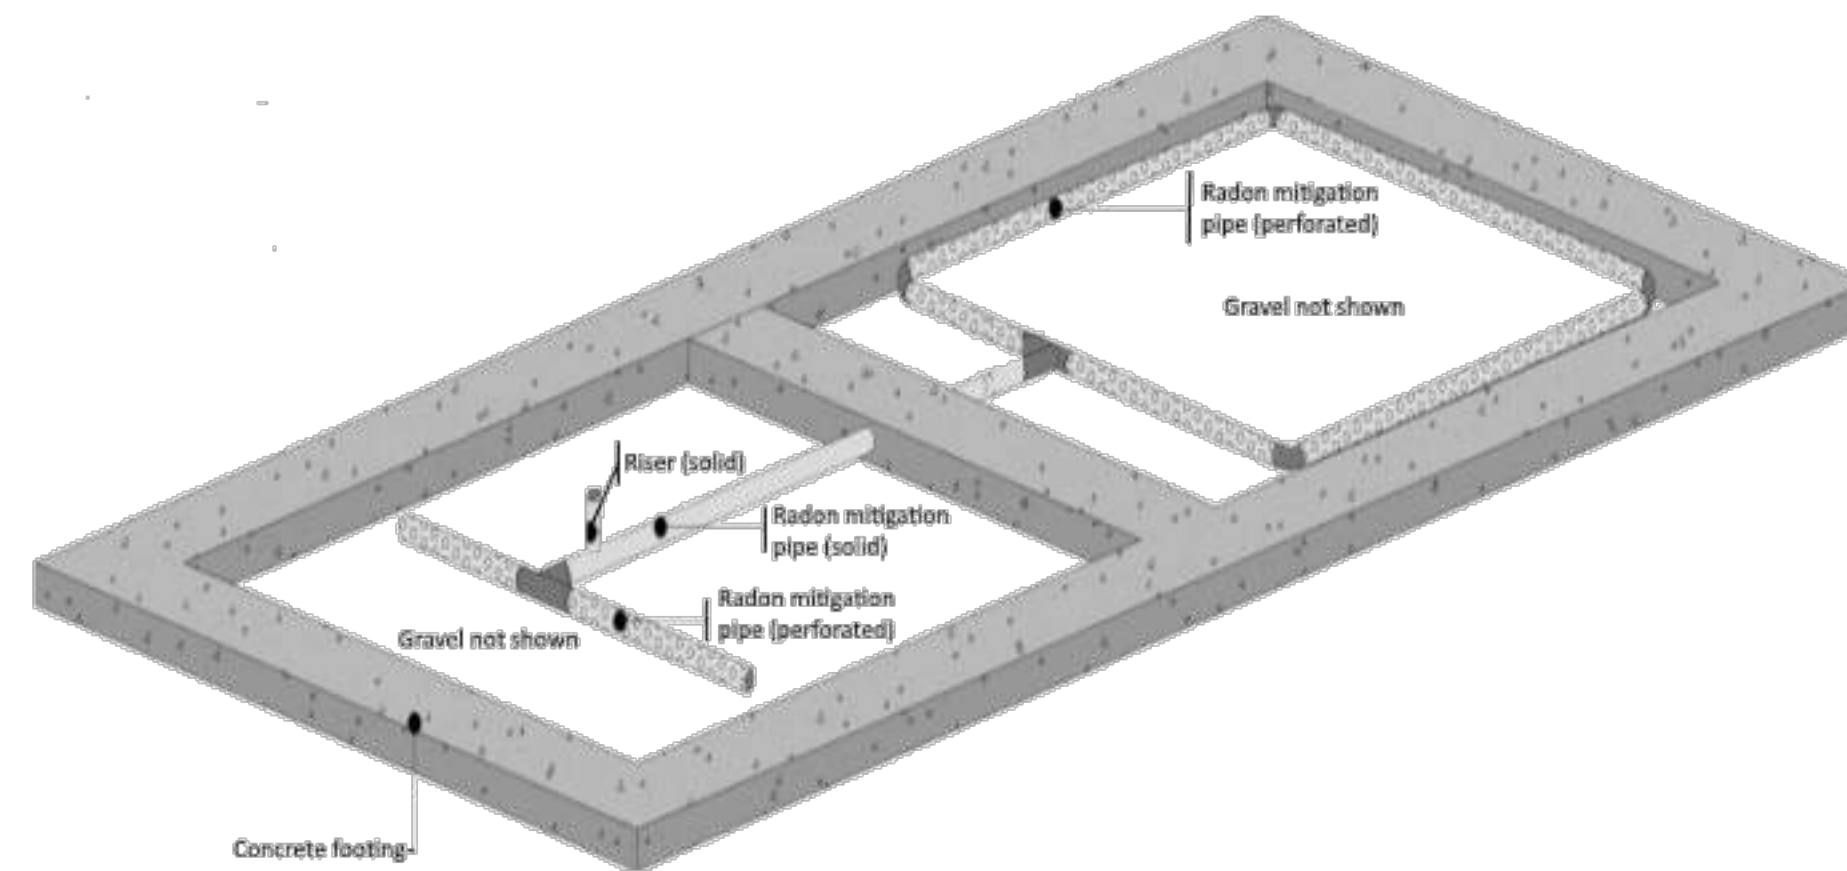


Figure 7.1.2.7— Possible interconnection of two gas permeable layers

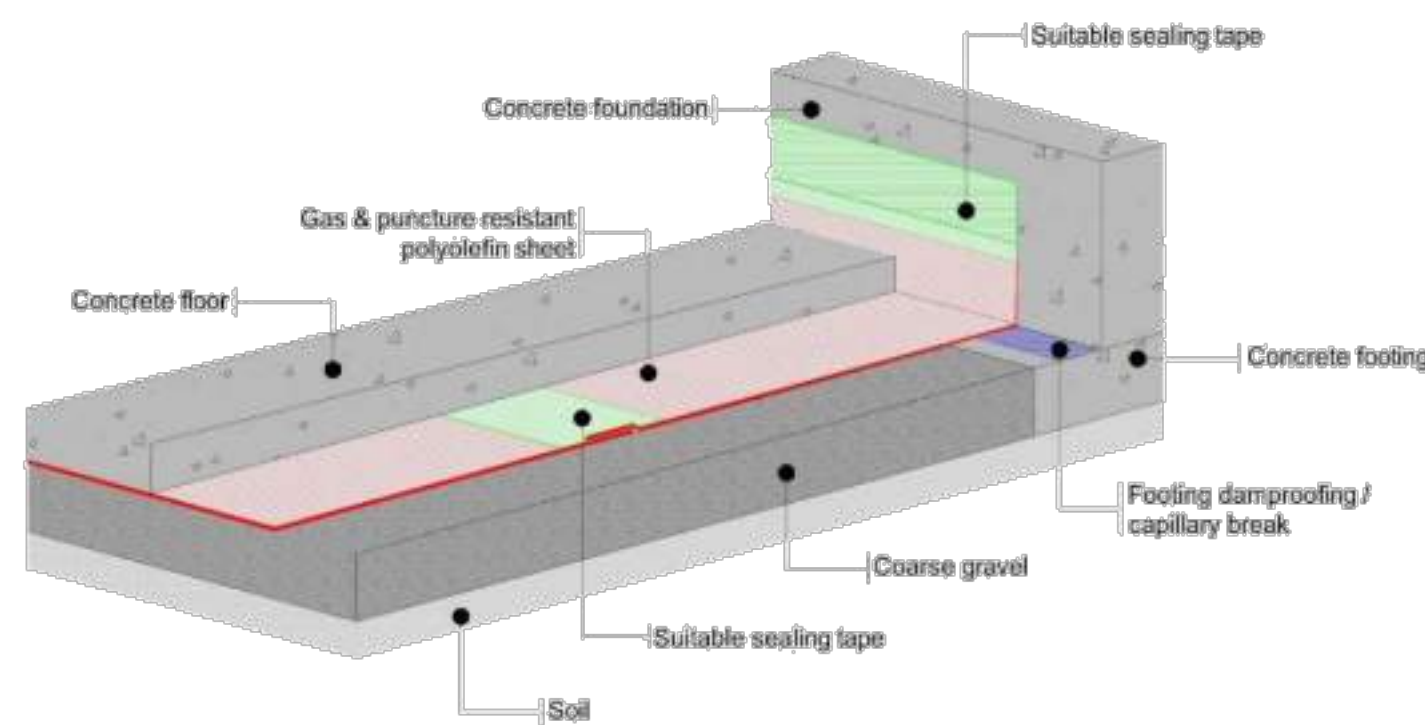


Figure 7.1.4.5.5 — Sealing sub-slab membrane vertically to concrete foundation wall

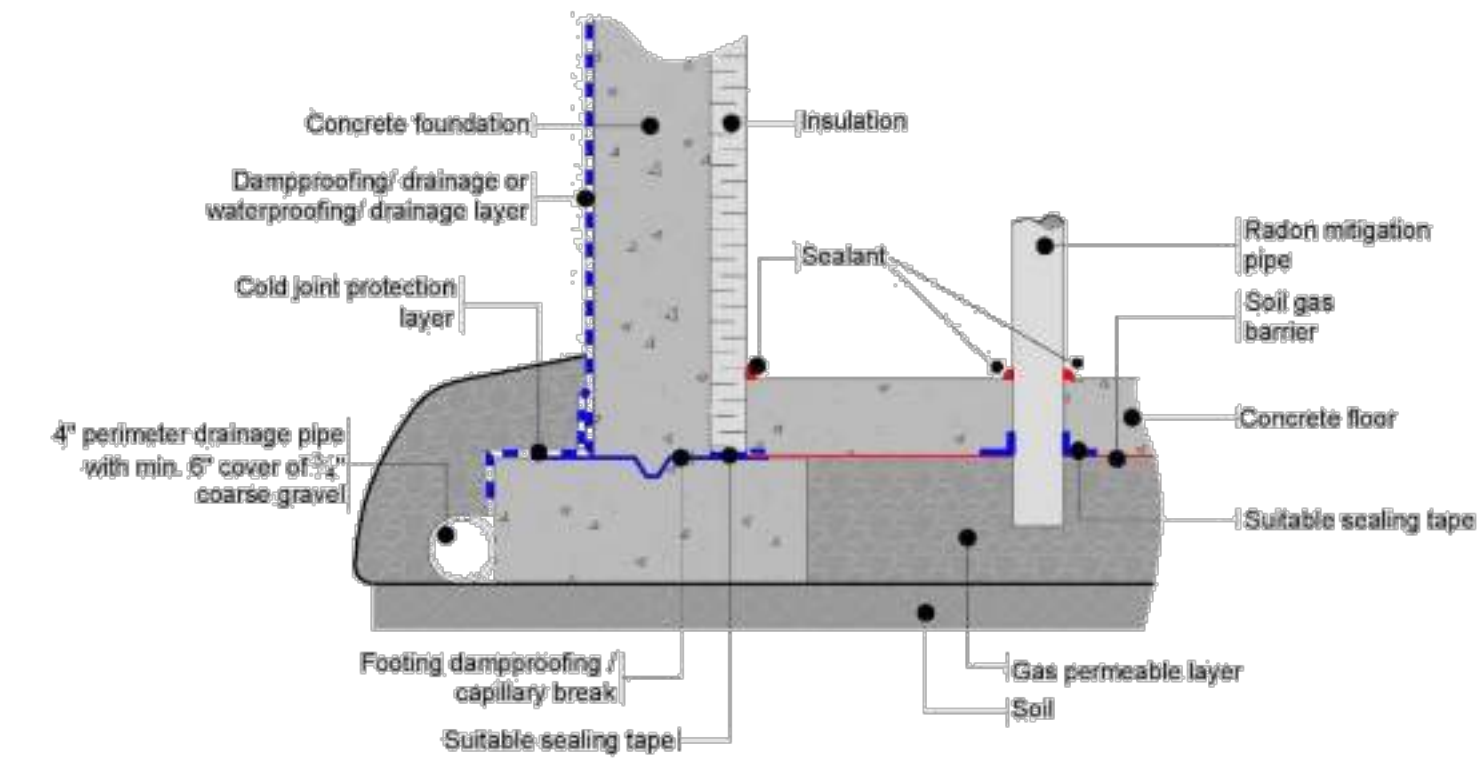


Figure 7.1.4.5.7 — Sealing sub-slab membrane horizontally to concrete footing when insulation is between the foundation wall and floor slab

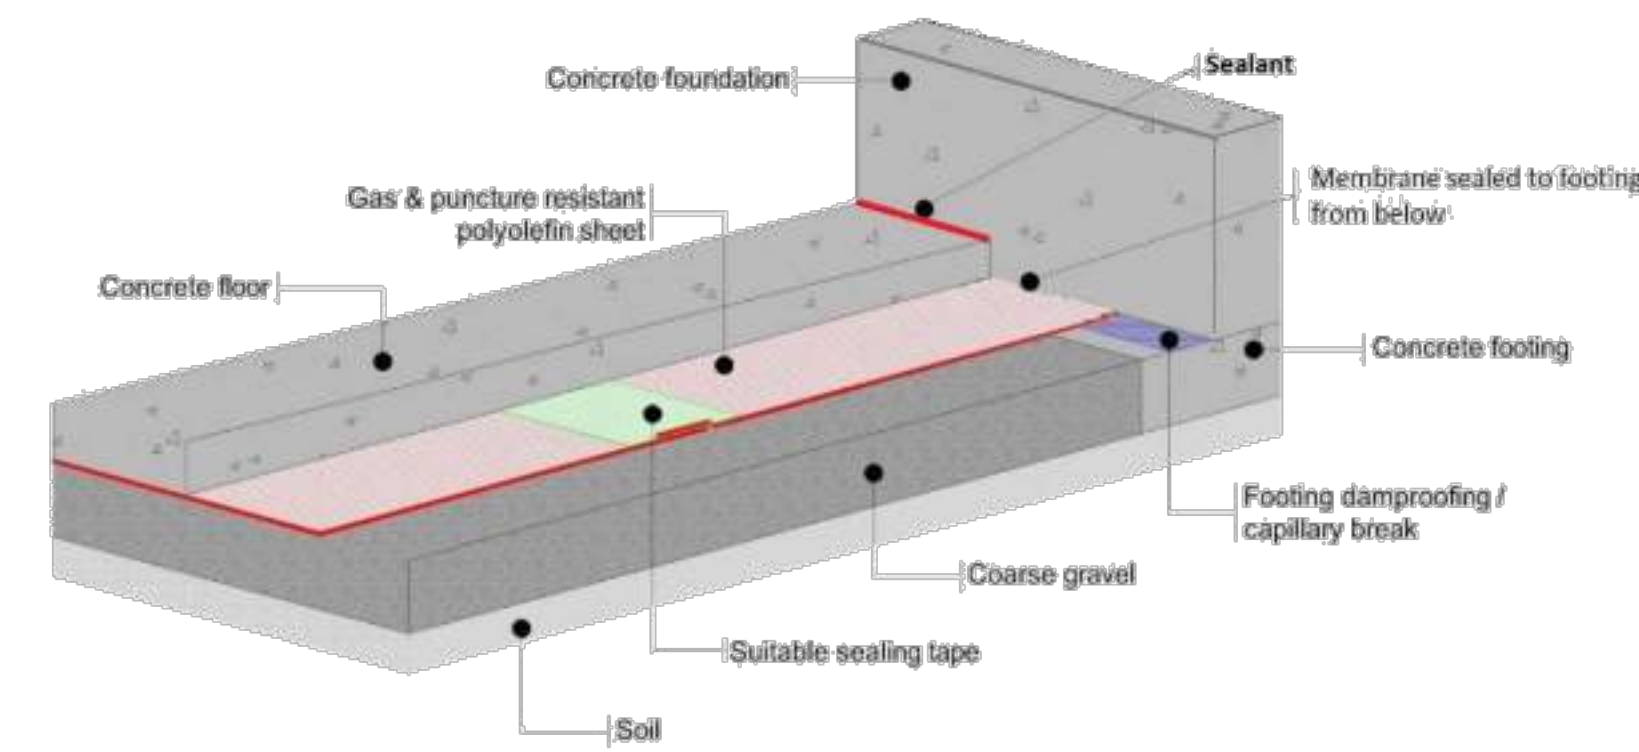


Figure 7.1.4.5.6 — Sealing sub-slab membrane horizontally to concrete footing prior to slab pour and of the slab/wall expansion joint after the slab pour

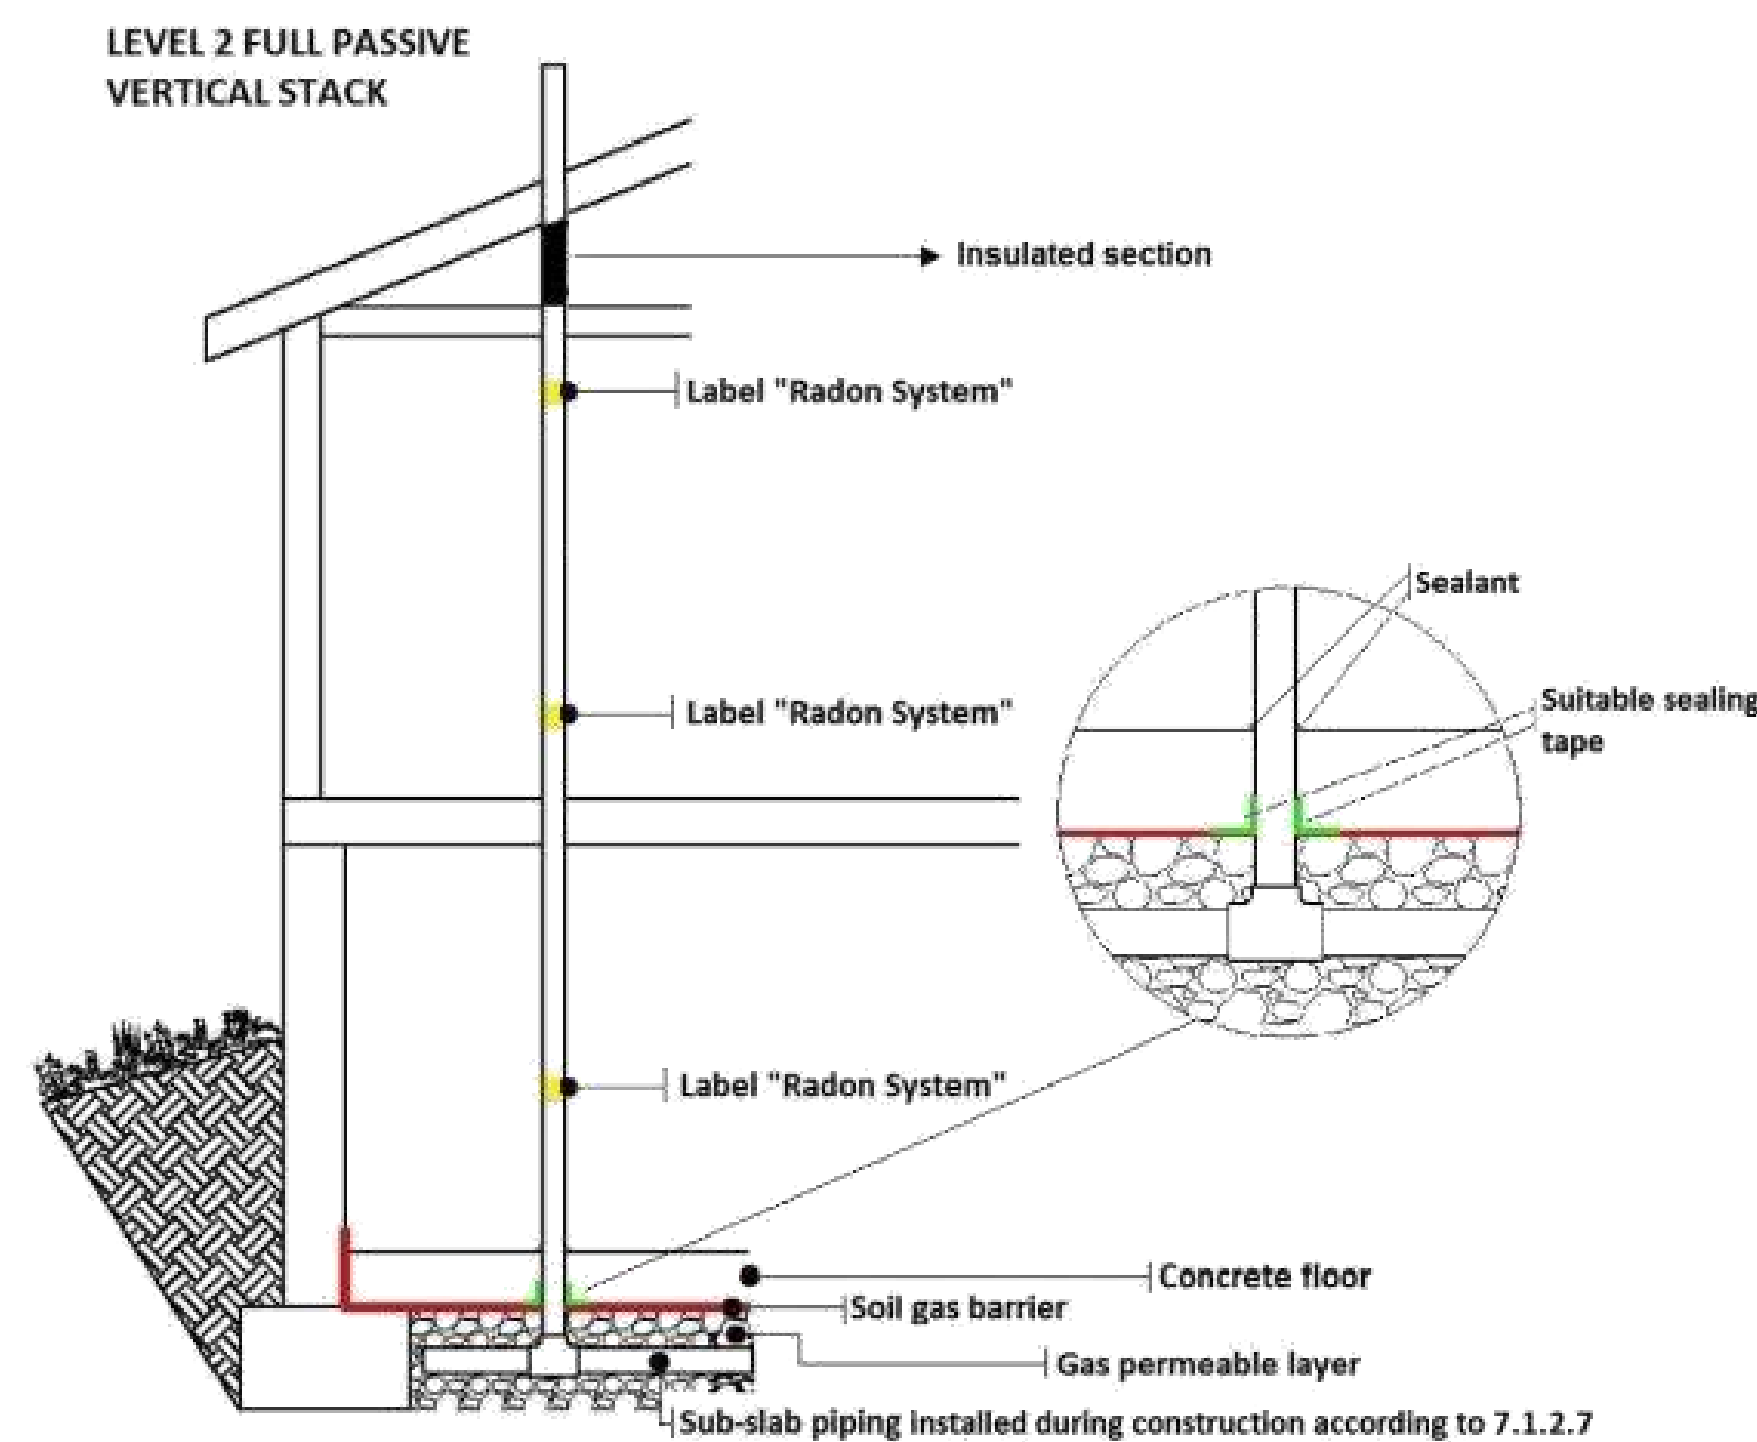


Figure 7.2b — Level 2 — Full passive vertical radon stack

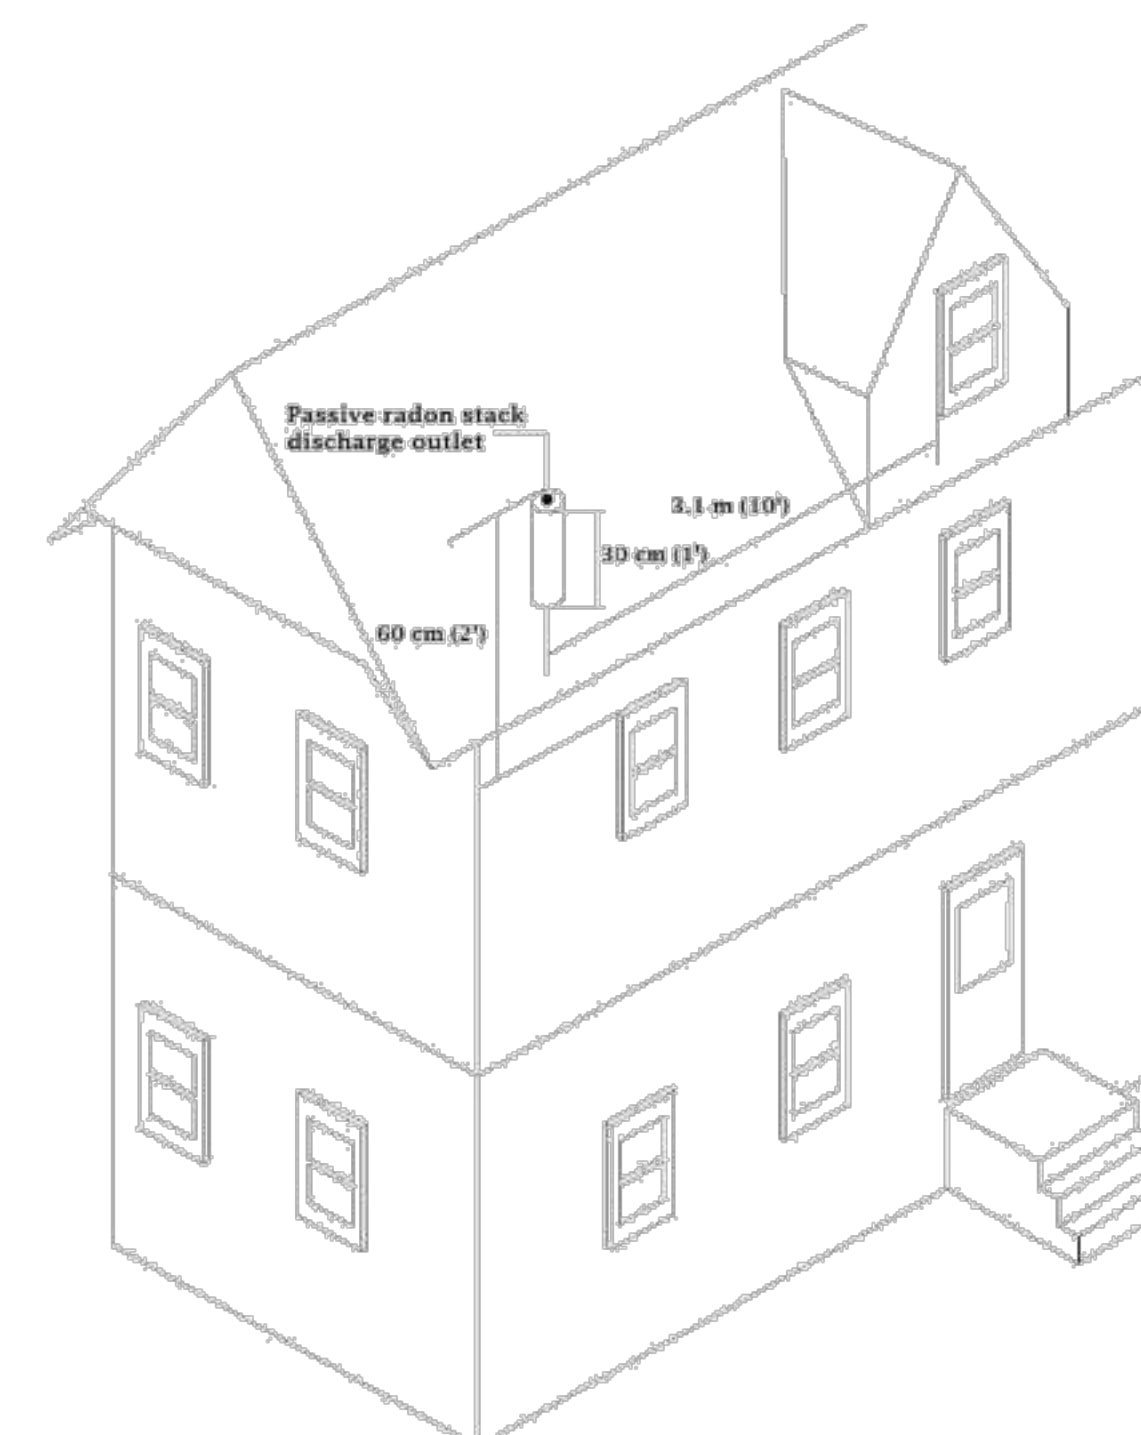


Figure 7.2.4.6 — Conceptual illustration of rooftop passive stack discharge geometry showing proximity to windows and height above roof

ADDRESS:
SL 10 - 924 ROSEFINCH PLACE,
LANGFORD
CUSTOMER:
TEKLOCH HOMES LTD.

DRAWING NAME:
RADON DETAILS
DRAWING SCALE:
SEE DRAWINGS

ISSUE DATE:
FEB 20, 2025
DRAWN BY:
LS
CHECKED BY:
KL

102 - 2871 JACKLIN ROAD
VICTORIA BC V9B 0P3
JAVADESIGN.CA
250.590.2468

JAVA DESIGNS

SHEET NUMBER

D2